

**Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council**

**WARNING!!** This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in the "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.

|                       |                             |               |                   |
|-----------------------|-----------------------------|---------------|-------------------|
| Street Number & Name: | <b>38 Mitchell Street</b>   | Job No.:      | <b>5-C3957.00</b> |
| AKA:                  |                             | By:           | <b>GSF</b>        |
| Name of building:     | <b>Epuni Community Hall</b> | Date:         | <b>28/08/2019</b> |
| City:                 | <b>Epuni, Hutt City</b>     | Revision No.: | <b>0</b>          |

**Table IEP-1 Initial Evaluation Procedure Step 1**


**Step 1 - General Information**

**1.1 Photos (attach sufficient to describe building)**



**NOTE: THERE ARE MORE PHOTOS ON PAGE 1a ATTACHED**

**1.2 Sketches (plans etc, show items of interest)**

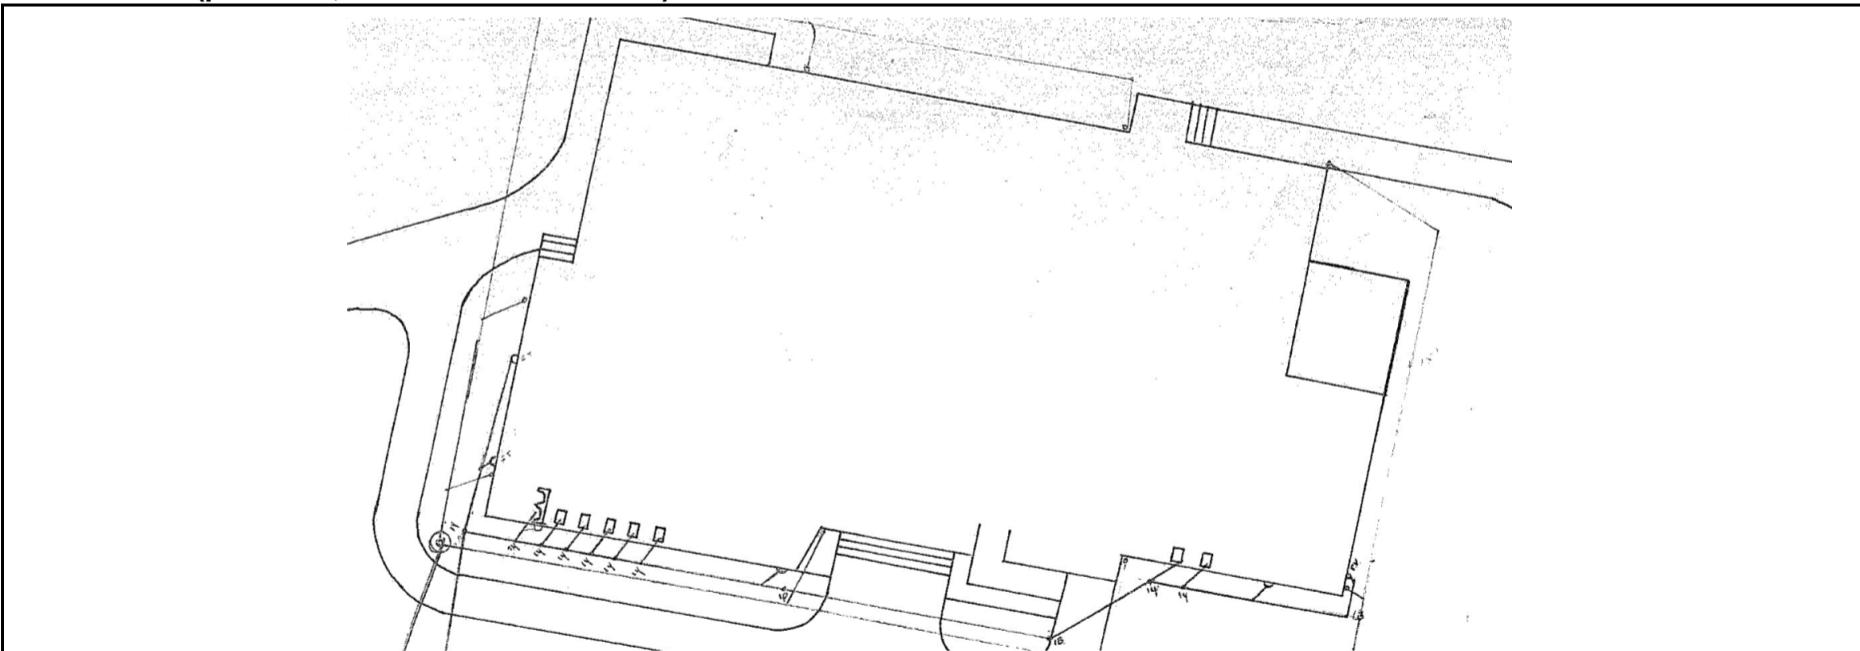

**1.3 List relevant features (Note: only 10 lines of text will print in this box. If further text required use Page 1a)**

Structure: Portal frames, lined timber framed walls with let in braces  
 Foundations: Piled foundations with pads under the portal frames and foundation walls.  
 Roof: Portals and timber frames support timber framing  
 Subsoil: D soft or deep soils - assumed based on location  
 Construction Date: 1953

**1.4 Note information sources**

Tick as appropriate

Visual Inspection of Exterior    
 Visual Inspection of Interior    
 Drawings (note type)

Specifications    
 Geotechnical Reports    
 Other (list)

Information Reviewed: Nil

**Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council**

|                       |                      |               |            |
|-----------------------|----------------------|---------------|------------|
| Street Number & Name: | 38 Mitchell Street   | Job No.:      | 5-C3957.00 |
| AKA:                  |                      | By:           | GSF        |
| Name of building:     | Epuni Community Hall | Date:         | 28/08/2019 |
| City:                 | Epuni, Hutt City     | Revision No.: | 0          |

**Table IEP-2 Initial Evaluation Procedure Step 2**

**Step 2 - Determination of (%NBS)<sub>b</sub>**

(Baseline (%NBS) for particular building - refer Section B5 )

**2.1 Determine nominal (%NBS) = (%NBS)<sub>nom</sub>**

**a) Building Strengthening Data**

Tick if building is known to have been strengthened in this direction

If strengthened, enter percentage of code the building has been strengthened to

Longitudinal

Transverse



N/A

N/A

**b) Year of Design/Strengthening, Building Type and Seismic Zone**

- Pre 1935
- 1935-1965
- 1965-1976
- 1976-1984
- 1984-1992
- 1992-2004
- 2004-2011
- Post Aug 2011

- Pre 1935
- 1935-1965
- 1965-1976
- 1976-1984
- 1984-1992
- 1992-2004
- 2004-2011
- Post Aug 2011

Building Type: Others

Building Type: Others

Seismic Zone: Not applicable

Seismic Zone: Not applicable

**c) Soil Type**

From NZS1170.5:2004, CI 3.1.3 :

D Soft Soil

D Soft Soil

From NZS4203:1992, CI 4.6.2.2 :  
(for 1992 to 2004 and only if known)

Not applicable

Not applicable

**d) Estimate Period, T**

Comment:

h<sub>n</sub> = 8  
A<sub>c</sub> = 1.00

8 m  
1.00 m<sup>2</sup>

- Moment Resisting Concrete Frames:  $T = \max(0.09h_n^{0.75}, 0.4)$
- Moment Resisting Steel Frames:  $T = \max(0.14h_n^{0.75}, 0.4)$
- Eccentrically Braced Steel Frames:  $T = \max(0.08h_n^{0.75}, 0.4)$
- All Other Frame Structures:  $T = \max(0.06h_n^{0.75}, 0.4)$
- Concrete Shear Walls:  $T = \max(0.09h_n^{0.75}/A_c^{0.5}, 0.4)$
- Masonry Shear Walls:  $T \leq 0.4\text{sec}$
- User Defined (input Period):

Where h<sub>n</sub> = height in metres from the base of the structure to the uppermost seismic weight or mass.

T: 0.40

0.40

**e) Factor A:** Strengthening factor determined using result from (a) above (set to 1.0 if not strengthened)

Factor A: 1.00

1.00

**f) Factor B:** Determined from NZSEE Guidelines Figure 3A.1 using results (a) to (e) above

Factor B: 0.03

0.03

**g) Factor C:** For reinforced concrete buildings designed between 1976-84 Factor C = 1.2, otherwise take as 1.0.

Factor C: 1.00

1.00

**h) Factor D:** For buildings designed prior to 1935 Factor D = 0.8 except for Wellington and Napier (1931-1935) where Factor D may be taken as 1.0, otherwise take as 1.0.

Factor D: 1.00

1.00

(%NBS)<sub>nom</sub> = AxBxCxD

(%NBS)<sub>nom</sub> 3%

3%

**WARNING!!** This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.

**Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council**

|                       |                      |               |            |
|-----------------------|----------------------|---------------|------------|
| Street Number & Name: | 38 Mitchell Street   | Job No.:      | 5-C3957.00 |
| AKA:                  |                      | By:           | GSF        |
| Name of building:     | Epuni Community Hall | Date:         | 28/08/2019 |
| City:                 | Epuni, Hutt City     | Revision No.: | 0          |

**Table IEP-2 Initial Evaluation Procedure Step 2 continued**

**2.2 Near Fault Scaling Factor, Factor E**

If  $T \leq 1.5\text{sec}$ , Factor E = 1

a) Near Fault Factor,  $N(T,D)$

(from NZS1170.5:2004, Cl 3.1.6)

Longitudinal

N(T,D):

Transverse

b) Factor E

=  $1/N(T,D)$

Factor E:

**2.3 Hazard Scaling Factor, Factor F**

a) Hazard Factor, Z, for site

Location:  Refer right for user-defined locations

Z =  (from NZS1170.5:2004, Table 3.3)

$Z_{1992}$  =  (NZS4203:1992 Zone Factor from accompanying Figure 3.5(b))

$Z_{2004}$  =  (from NZS1170.5:2004, Table 3.3)

b) Factor F

For pre 1992

=  $1/Z$

For 1992-2011

=  $Z_{1992}/Z$

For post 2011

=  $Z_{2004}/Z$

Factor F:

**2.4 Return Period Scaling Factor, Factor G**

a) Design Importance Level, I

(Set to 1 if not known. For buildings designed prior to 1965 and known to be designed as a public building set to 1.25. For buildings designed 1965-1976 and known to be designed as a public building set to 1.33 for Zone A or 1.2 for Zone B. For 1976-1984 set I value.)

I =

b) Design Risk Factor,  $R_o$

(set to 1.0 if other than 1976-2004, or not known)

$R_o$  =

c) Return Period Factor, R

(from NZS1170.0:2004 Building Importance Level)

Choose Importance Level

1  2  3  4

1  2  3  4

R =

d) Factor G

=  $IR_o/R$

Factor G:

**2.5 Ductility Scaling Factor, Factor H**

a) Available Displacement Ductility Within Existing Structure

Comment:

Portal frames with braced timber framed walls in both directions

$\mu$  =

b) Factor H

For pre 1976 (maximum of 2)  
For 1976 onwards

=  $k_\mu$   
= 1.57  
= 1  
Factor H:

$k_\mu$   
1.57  
1

(where  $k_\mu$  is NZS1170.5:2004 Inelastic Spectrum Scaling Factor, from accompanying Table 3.3)

**2.6 Structural Performance Scaling Factor, Factor I**

a) Structural Performance Factor,  $S_p$

(from accompanying Figure 3.4)

Tick if light timber-framed construction in this direction

$S_p$  =

b) Structural Performance Scaling Factor

=  $1/S_p$

Factor I:

Note Factor B values for 1992 to 2004 have been multiplied by 0.67 to account for  $S_p$  in this period

**2.7 Baseline %NBS for Building, (%NBS)<sub>b</sub>**

(equals (%NBS)<sub>nom</sub> x E x F x G x H x I )

**WARNING!!** This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.



**Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council**

|                       |                      |               |            |
|-----------------------|----------------------|---------------|------------|
| Street Number & Name: | 38 Mitchell Street   | Job No.:      | 5-C3957.00 |
| AKA:                  |                      | By:           | GSF        |
| Name of building:     | Epuni Community Hall | Date:         | 28/08/2019 |
| City:                 | Epuni, Hutt City     | Revision No.: | 0          |

**Table IEP-3 Initial Evaluation Procedure Step 3**

**Step 3 - Assessment of Performance Achievement Ratio (PAR)**

(Refer Appendix B - Section B3.2)

**a) Longitudinal Direction**

| potential CSWs  | Effect on Structural Performance<br>(Choose a value - Do not interpolate) | Factors      |
|---|---|--------------|
| <b>3.1 Plan Irregularity</b><br>Effect on Structural Performance <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant<br>Comment: Nil    |   | Factor A 1.0 |
| <b>3.2 Vertical Irregularity</b><br>Effect on Structural Performance <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant<br>Comment: nā |   | Factor B 1.0 |
| <b>3.3 Short Columns</b><br>Effect on Structural Performance <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant<br>Comment: Nil        |   | Factor C 1.0 |
| <b>3.4 Pounding Potential</b><br>(Estimate D1 and D2 and set D = the lower of the two, or 1.0 if no potential for pounding, or consequences are considered to be minimal)                         |   |              |

**a) Factor D1: - Pounding Effect**

**Note:**  
 Values given assume the building has a frame structure. For stiff buildings (eg shear walls), the effect of pounding may be reduced by taking the coefficient to the right of the value applicable to frame buildings.

**Factor D1 For Longitudinal Direction:** 1.0

| Table for Selection of Factor D1                    | Severe<br>0<Sep<.005H     | Significant<br>.005<Sep<.01H | Insignificant<br>Sep>.01H          |
|---|---------------------------|------------------------------|------------------------------------|
| Alignment of Floors within 20% of Storey Height     | <input type="radio"/> 1   | <input type="radio"/> 1      | <input checked="" type="radio"/> 1 |
| Alignment of Floors not within 20% of Storey Height | <input type="radio"/> 0.4 | <input type="radio"/> 0.7    | <input type="radio"/> 0.8          |

nā

**b) Factor D2: - Height Difference Effect**

**Factor D2 For Longitudinal Direction:** 1.0

| Table for Selection of Factor D2 | Severe<br>0<Sep<.005H     | Significant<br>.005<Sep<.01H | Insignificant<br>Sep>.01H          |
|----------------------------------|---------------------------|------------------------------|------------------------------------|
| Height Difference > 4 Storeys    | <input type="radio"/> 0.4 | <input type="radio"/> 0.7    | <input checked="" type="radio"/> 1 |
| Height Difference 2 to 4 Storeys | <input type="radio"/> 0.7 | <input type="radio"/> 0.9    | <input type="radio"/> 1            |
| Height Difference < 2 Storeys    | <input type="radio"/> 1   | <input type="radio"/> 1      | <input type="radio"/> 1            |

nā

**Factor D** 1.0

**3.5 Site Characteristics - Stability, landslide threat, liquefaction etc as it affects the structural performance from a life-safety perspective**

|  |          |     |
|--|----------|-----|
| Effect on Structural Performance <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant | Factor E | 1.0 |
| Comment: None  |          |     |

**3.6 Other Factors - for allowance of all other relevant characteristics of the building**

For ≤ 3 storeys - Maximum value 2.5  
 otherwise - Maximum value 1.5.  
 No minimum.

**Factor F** 2.5

**Record rationale for choice of Factor F:**  
 Comment: Portal frames, lightweight roof, braced and lined timber framed walls F factor 2.5

**3.7 Performance Achievement Ratio (PAR)**  
 (equals A x B x C x D x E x F)

**PAR**  
**Longitudinal** 2.50

**WARNING!!** This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.

**Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council**

|                       |                      |               |            |
|-----------------------|----------------------|---------------|------------|
| Street Number & Name: | 38 Mitchell Street   | Job No.:      | 5-C3957.00 |
| AKA:                  |                      | By:           | GSF        |
| Name of building:     | Epuni Community Hall | Date:         | 28/08/2019 |
| City:                 | Epuni, Hutt City     | Revision No.: | 0          |

**Table IEP-3 Initial Evaluation Procedure Step 3**

**Step 3 - Assessment of Performance Achievement Ratio (PAR)**

(Refer Appendix B - Section B3.2)

**b) Transverse Direction**

| potential CSWs  | Effect on Structural Performance<br>(Choose a value - Do not interpolate) | Factors             |
|---|---|---------------------|
| <b>3.1 Plan Irregularity</b><br>Effect on Structural Performance <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant<br>Comment: Nil    |   | <b>Factor A</b> 1.0 |
| <b>3.2 Vertical Irregularity</b><br>Effect on Structural Performance <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant<br>Comment: nā |   | <b>Factor B</b> 1.0 |
| <b>3.3 Short Columns</b><br>Effect on Structural Performance <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant<br>Comment: Nil        |   | <b>Factor C</b> 1.0 |
| <b>3.4 Pounding Potential</b><br>(Estimate D1 and D2 and set D = the lower of the two, or 1.0 if no potential for pounding, or consequences are considered to be minimal)                         |   |                     |

**a) Factor D1: - Pounding Effect**

**Note:**  
 Values given assume the building has a frame structure. For stiff buildings (eg shear walls), the effect of pounding may be reduced by taking the coefficient to the right of the value applicable to frame buildings.

**Factor D1 For Transverse Direction:** 1.0

| Table for Selection of Factor D1                    | Severe<br>0<Sep<.005H     | Significant<br>.005<Sep<.01H | Insignificant<br>Sep>.01H          |
|---|---------------------------|------------------------------|------------------------------------|
| Alignment of Floors within 20% of Storey Height     | <input type="radio"/> 1   | <input type="radio"/> 1      | <input checked="" type="radio"/> 1 |
| Alignment of Floors not within 20% of Storey Height | <input type="radio"/> 0.4 | <input type="radio"/> 0.7    | <input type="radio"/> 0.8          |

Comment: Nil

**b) Factor D2: - Height Difference Effect**

**Factor D2 For Transverse Direction:** 1.0

| Table for Selection of Factor D2 | Severe<br>0<Sep<.005H     | Significant<br>.005<Sep<.01H | Insignificant<br>Sep>.01H          |
|----------------------------------|---------------------------|------------------------------|------------------------------------|
| Height Difference > 4 Storeys    | <input type="radio"/> 0.4 | <input type="radio"/> 0.7    | <input checked="" type="radio"/> 1 |
| Height Difference 2 to 4 Storeys | <input type="radio"/> 0.7 | <input type="radio"/> 0.9    | <input type="radio"/> 1            |
| Height Difference < 2 Storeys    | <input type="radio"/> 1   | <input type="radio"/> 1      | <input type="radio"/> 1            |

Comment: nā

**Factor D** 1.0

**3.5 Site Characteristics - Stability, landslide threat, liquefaction etc as it affects the structural performance from a life-safety perspective**

|  |                     |
|--|---------------------|
| Effect on Structural Performance <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant | <b>Factor E</b> 1.0 |
| Comment: Nil   |                     |

**3.6 Other Factors - for allowance of all other relevant characteristics of the building**

For ≤ 3 storeys - Maximum value 2.5  
 otherwise - Maximum value 1.5.  
 No minimum.

**Factor F** 2.50

**Record rationale for choice of Factor F:**  
 Comment: Portal frames, lightweight roof, braced and lined timber framed walls F factor 2.5

**3.7 Performance Achievement Ratio (PAR)**  
 (equals A x B x C x D x E x F)

**PAR**  
**Transverse** 2.50

**WARNING!!** This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.

**Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council**

|                       |                      |               |            |
|-----------------------|----------------------|---------------|------------|
| Street Number & Name: | 38 Mitchell Street   | Job No.:      | 5-C3957.00 |
| AKA:                  |                      | By:           | GSF        |
| Name of building:     | Epuni Community Hall | Date:         | 28/08/2019 |
| City:                 | Epuni, Hutt City     | Revision No.: | 0          |

**Table IEP-4 Initial Evaluation Procedure Steps 4, 5, 6 and 7**

**Step 4 - Percentage of New Building Standard (%NBS)**

|   | Longitudinal | Transverse |
|---|--------------|------------|
| 4.1 Assessed Baseline %NBS (%NBS) <sub>b</sub><br>(from Table IEP - 1)                                  | 16%          | 16%        |
| 4.2 Performance Achievement Ratio (PAR)<br>(from Table IEP - 2)   | 2.50         | 2.50       |
| 4.3 PAR x Baseline (%NBS) <sub>b</sub>  | 40%          | 40%        |
| 4.4 Percentage New Building Standard (%NBS) - Seismic Rating<br>(Use lower of two values from Step 4.3) |              | 40%        |

**Step 5 - Is %NBS < 34?**

NO

**Step 6 - Potentially Earthquake Risk (is %NBS < 67)?**

YES

**Step 7 - Provisional Grading for Seismic Risk based on IEP**

Seismic Grade **C**

**Additional Comments (items of note affecting IEP based seismic rating)**

Comment: Nil

**Relationship between Grade and %NBS:**

| Grade: | A+    | A         | B        | C        | D          | E    |
|--------|-------|-----------|----------|----------|------------|------|
| %NBS:  | > 100 | 100 to 80 | 79 to 67 | 66 to 34 | < 34 to 20 | < 20 |

**WARNING!!** This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.

**Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council**

|                       |                      |               |            |
|-----------------------|----------------------|---------------|------------|
| Street Number & Name: | 38 Mitchell Street   | Job No.:      | 5-C3957.00 |
| AKA:                  |                      | By:           | GSF        |
| Name of building:     | Epuni Community Hall | Date:         | 28/08/2019 |
| City:                 | Epuni, Hutt City     | Revision No.: | 0          |

**Table IEP-5 Initial Evaluation Procedure Step 8**

**Step 8 - Identification of potential Severe Structural Weaknesses (SSWs) that could result in significant risk to a significant number of occupants**

- 8.1 Number of storeys above ground level 1
- 8.2 Presence of heavy concrete floors and/or concrete roof? (Y/N) N

**Potential Severe Structural Weaknesses (SSWs):**

Note: Options that are greyed out are not applicable and need not be considered.


**Occupancy not considered to be significant - no further consideration required**

**Risk not considered to be significant - no further consideration required**

The following potential Severe Structural Weaknesses (SSWs) have been identified in the building that could result in significant risk to a significant number of occupants:

1. None identified
2. Weak or soft storey (except top storey)
3. Brittle columns and/or beam-column joints the deformations of which are not constrained by other structural elements
4. Flat slab buildings with lateral capacity reliant on low ductility slab-to-column connections
5. No identifiable connection between primary structure and diaphragms
6. Ledge and gap stairs

**IEP Assessment Confirmed by**



**WARNING!!** This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.



**Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council**

|                       |                      |               |            |
|-----------------------|----------------------|---------------|------------|
| Street Number & Name: | 38 Mitchell Street   | Job No.:      | 5-C3957.00 |
| AKA:                  |                      | By:           | GSF        |
| Name of building:     | Epuni Community Hall | Date:         | 28/08/2019 |
| City:                 | Epuni, Hutt City     | Revision No.: | 0          |

**Table IEP-1a Additional Photos and Sketches**



**WARNING!!** This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.



| <b>1. Building Information</b>   |  |
|--|--|
| Building Name/<br>Description  | Epuni Community Hall   |
| Street Address   | 38 Mitchell Street, Epuni  |
| Territorial Authority  | Hutt City Council  |
| No. of Storeys   | 1  |
| Area of Typical Floor<br>(approx.)   | 600 sqm  |
| Year of Design (approx.)   | 1953   |
| NZ Standards designed<br>to  | NA   |
| Structural System<br>including Foundations   | Piled foundations with pads under the portal frames.<br>Portal frames and lined timber framed walls with let in braces.<br>Portal and timber frames support timber framing and lightweight cladding. |
| Does the building<br>comprise a shared<br>structural form or shares<br>structural elements with<br>any other adjacent<br>titles? | No   |
| Key features of ground<br>profile and identified<br>geohazards   | Nil - Generally flat under the building and wider site   |
| Previous strengthening<br>and/ or significant<br>alteration  | None identified  |
| Heritage Issues/ Status  | Nil  |
| Other Relevant<br>Information  | Seismic Hazard Map Series: Liquefaction Hazard, Map Sheet 3, 1993<br>Liquefaction Hazard Hutt Valley.  |

| <b>2. Assessment Information</b>  |   |
|---|---|
| Consulting Practice   |   |
| CPEng Responsible, including: <ul style="list-style-type: none"> <li>• Name</li> <li>• CPEng number</li> <li>• A statement of suitable skills and experience in the seismic assessment of existing buildings<sup>1</sup></li> </ul> |   |
| Documentation reviewed, including: <ul style="list-style-type: none"> <li>• date/ version of drawings/ calculations<sup>2</sup></li> <li>• previous seismic assessments</li> </ul>  | Drawings:<br>Nil, age confirmed by drainage drawings and plaque       |
| Geotechnical Report(s)  | NA – subsoil assumed based on local knowledge and Seismic Hazard Maps |
| Date(s) Building Inspected and extent of inspection   | 28 August 2019  |
| Description of any structural testing undertaken and results summary  | None  |
| Previous Assessment Reports   | NA  |
| Other Relevant Information  | Nil   |

<sup>1</sup> This should include reference to the engineer's Practice Field being in Structural Engineering, and commentary on experience in seismic assessment and recent relevant training

<sup>2</sup> Or justification of assumptions if no drawings were able to be obtained

| <b>3. Summary of Engineering Assessment Methodology and Key Parameters Used</b>  |  |
|--|--|
| Occupancy Type(s) and Importance Level   | Importance Level 2   |
| Site Subsoil Class   | D assumed based on local knowledge and <b><i>NZS1170.5:2004 Site Subsoil Classification of Lower Hutt</i></b> <a href="http://nzsee.org.nz/db/2011/013.pdf">http://nzsee.org.nz/db/2011/013.pdf</a>  |
| <b><u>For an ISA:</u></b>  |  |
| Summary of how Part B was applied, including: <ul style="list-style-type: none"> <li>• Key parameters such as <math>\mu</math>, <math>S_p</math> and F factors</li> <li>• Any supplementary specific calculations</li> </ul> | Ductility<br>Longitudinal – 2.0 Portal frames and timber bracing walls<br>Transverse – Lined timber framed walls<br><br>Sp Factor – 0.70<br><br>F Factor – 2.5 longitudinal (maximum) braced and lined timber framed walls.<br>2.5 – transverse (maximum) portal frames and lined timber framed walls. |
| <b><u>For a DSA:</u></b>   |  |
| Summary of how Part C was applied, including: <ul style="list-style-type: none"> <li>• the analysis methodology(s) used from C2</li> <li>• other sections of Part C applied</li> </ul>                                       | NA   |
| Other Relevant Information   | NA   |



| <b>4. Assessment Outcomes</b>  |  |  |
|--|--|--|
| Assessment Status<br>(Draft or Final)  | Final  |  |
| Assessed %NBS Rating   | 40%NBS IL2   |  |
| Seismic Grade and Relative Risk (from Table A3.1)  | C Grade 5 to 10 times risk comparable to new building                        |  |
| <b>For an ISA:</b>   |  |  |
| Describe the Potential Critical Structural Weaknesses  | None identified  |  |
| Does the result reflect the building's expected behaviour, or is more information/ analysis required?  | Yes – the ISA is sufficient  |  |
| If the results of this ISA are being used for earthquake prone decision purposes, <u>and</u> elements rating <34%NBS have been identified:                                 | <b>Engineering Statement of Structural Weaknesses and Location</b><br><br>NA | <b>Mode of Failure and Physical Consequence Statement(s)</b><br><br>NA |
| <b>For a DSA:</b>  |  |  |
| Comment on the nature of Secondary Structural and Non-structural elements/ parts identified and assessed   |  |  |
| Describe the Governing Critical Structural Weakness  |  |  |
| If the results of this DSA are being used for earthquake prone decision purposes, <u>and</u> elements rating <34%NBS have been identified (including Parts) <sup>3</sup> : | <b>Engineering Statement of Structural Weaknesses and Location</b>           | <b>Mode of Failure and Physical Consequence Statement(s)</b>           |
| Recommendations<br>(optional for EPB purposes)   |  |  |

<sup>3</sup> If a building comprises a shared structural form or shares structural elements with other adjacent titles, information about the extent to which the low scoring elements affect, or do not affect the structure.