

Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council

WARNING!! This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in the "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.

Street Number & Name:	135 Dowse Drive	Job No.:	5-C3957.00
AKA:		By:	GSF
Name of building:	Maungaraki Hall and Community Centre	Date:	4/09/2019
City:	Maungaraki, Hutt City	Revision No.:	0

Table IEP-1 Initial Evaluation Procedure Step 1


Step 1 - General Information

1.1 Photos (attach sufficient to describe building)



NOTE: THERE ARE MORE PHOTOS ON PAGE 1a ATTACHED

1.2 Sketches (plans etc, show items of interest)

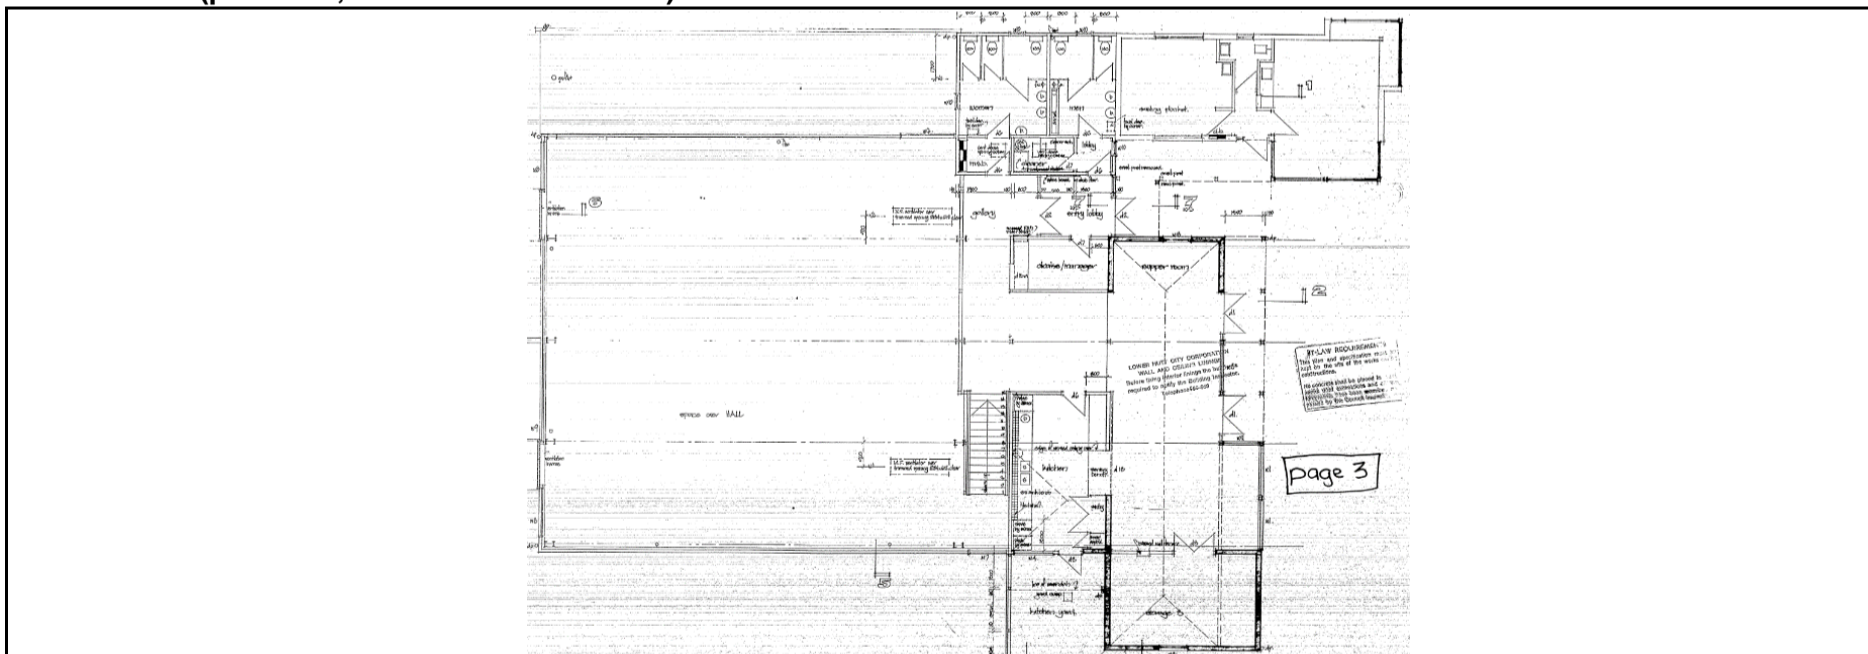

1.3 List relevant features (Note: only 10 lines of text will print in this box. If further text required use Page 1a)

Structure: Mixed system. Steel portal frame Hall, Upper level 12mm particle braced walls with lightweight timber roof and cladding (12mm particle board diaphragm), RC Masonry walls D12@400 vertical and 2x D10@ 2nd course bondbeams horizontal at lower level.

Foundations: Concrete slab on grade and reinforced foundation walls and tie beams, pads under portal frames

Roof: Steel framed with ply and other bracings

Subsoil: C Shallow Soils - NZS1170.5:2004 Site Subsoil Classification of Lower Hutt

Construction Date: 1981

1.4 Note information sources

Tick as appropriate

Visual Inspection of Exterior

Visual Inspection of Interior

Drawings (note type)

Specifications

Geotechnical Reports

Other (list)

Information Reviewed: Design drawings 1981 - various

Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council

Street Number & Name:	135 Dowse Drive	Job No.:	5-C3957.00
AKA:		By:	GSF
Name of building:	Maungaraki Hall and Community Centre	Date:	4/09/2019
City:	Maungaraki, Hutt City	Revision No.:	0

Table IEP-2 Initial Evaluation Procedure Step 2

Step 2 - Determination of (%NBS)_b

(Baseline (%NBS) for particular building - refer Section B5)

2.1 Determine nominal (%NBS) = (%NBS)_{nom}

a) Building Strengthening Data

Tick if building is known to have been strengthened in this direction

If strengthened, enter percentage of code the building has been strengthened to

Longitudinal

Transverse

N/A

N/A

b) Year of Design/Strengthening, Building Type and Seismic Zone

- Pre 1935
- 1935-1965
- 1965-1976
- 1976-1984
- 1984-1992
- 1992-2004
- 2004-2011
- Post Aug 2011

- Pre 1935
- 1935-1965
- 1965-1976
- 1976-1984
- 1984-1992
- 1992-2004
- 2004-2011
- Post Aug 2011

Building Type: Others

Building Type: Others

Seismic Zone: Zone A

Seismic Zone: Zone A

c) Soil Type

From NZS1170.5:2004, CI 3.1.3 :

C Shallow Soil

C Shallow Soil

From NZS4203:1992, CI 4.6.2.2 :
(for 1992 to 2004 and only if known)

Not applicable

Not applicable

d) Estimate Period, T

Comment:

h_n = 8
A_c = 1.00

8 m
1.00 m²

- Moment Resisting Concrete Frames: $T = \max(0.09h_n^{0.75}, 0.4)$
- Moment Resisting Steel Frames: $T = \max(0.14h_n^{0.75}, 0.4)$
- Eccentrically Braced Steel Frames: $T = \max(0.08h_n^{0.75}, 0.4)$
- All Other Frame Structures: $T = \max(0.06h_n^{0.75}, 0.4)$
- Concrete Shear Walls: $T = \max(0.09h_n^{0.75}/A_c^{0.5}, 0.4)$
- Masonry Shear Walls: $T \leq 0.4\text{sec}$
- User Defined (input Period):

-
-
-
-
-
-
-

Where h_n = height in metres from the base of the structure to the uppermost seismic weight or mass.

T: 0.40

0.40

e) Factor A: Strengthening factor determined using result from (a) above (set to 1.0 if not strengthened)

Factor A: 1.00

1.00

f) Factor B: Determined from NZSEE Guidelines Figure 3A.1 using results (a) to (e) above

Factor B: 0.25

0.25

g) Factor C: For reinforced concrete buildings designed between 1976-84 Factor C = 1.2, otherwise take as 1.0.

Factor C: 1.00

1.00

h) Factor D: For buildings designed prior to 1935 Factor D = 0.8 except for Wellington and Napier (1931-1935) where Factor D may be taken as 1.0, otherwise take as 1.0.

Factor D: 1.00

1.00

(%NBS)_{nom} = AxBxCxD

(%NBS)_{nom} 25%

25%

WARNING!! This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.

Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council

Street Number & Name:	135 Dowse Drive	Job No.:	5-C3957.00
AKA:		By:	GSF
Name of building:	Maungaraki Hall and Community Centre	Date:	4/09/2019
City:	Maungaraki, Hutt City	Revision No.:	0

Table IEP-2 Initial Evaluation Procedure Step 2 continued

2.2 Near Fault Scaling Factor, Factor E

If $T \leq 1.5\text{sec}$, Factor E = 1

a) Near Fault Factor, $N(T,D)$

(from NZS1170.5:2004, Cl 3.1.6)

Longitudinal

N(T,D): 1

Transverse

1

b) Factor E

= $1/N(T,D)$

Factor E: 1.00

1.00

2.3 Hazard Scaling Factor, Factor F

a) Hazard Factor, Z, for site

Location: Hutt Valley-south of Taita Gorge Refer right for user-defined locations

Z = 0.4 (from NZS1170.5:2004, Table 3.3)

Z_{1992} = 1.2 (NZS4203:1992 Zone Factor from accompanying Figure 3.5(b))

Z_{2004} = 0.4 (from NZS1170.5:2004, Table 3.3)

b) Factor F

For pre 1992

= $1/Z$

For 1992-2011

= Z_{1992}/Z

For post 2011

= Z_{2004}/Z

Factor F: 2.50

2.50

2.4 Return Period Scaling Factor, Factor G

a) Design Importance Level, I

(Set to 1 if not known. For buildings designed prior to 1965 and known to be designed as a public building set to 1.25. For buildings designed 1965-1976 and known to be designed as a public building set to 1.33 for Zone A or 1.2 for Zone B. For 1976-1984 set I value.)

I = 1

1

b) Design Risk Factor, R_o

(set to 1.0 if other than 1976-2004, or not known)

R_o = 1

1

c) Return Period Factor, R

(from NZS1170.0:2004 Building Importance Level)

Choose Importance Level

1 2 3 4

R = 1.3

1 2 3 4

1.3

d) Factor G

= IR_o/R

Factor G: 0.77

0.77

2.5 Ductility Scaling Factor, Factor H

a) Available Displacement Ductility Within Existing Structure

Comment:

Mixed ductilities - limited by reinforced masonry walls

μ = 1.25

1.25

b) Factor H

For pre 1976 (maximum of 2)
For 1976 onwards

= k_μ
= 1.14
= 1

Factor H: 1.00

k_μ
1.14
1

1.00

(where k_μ is NZS1170.5:2004 Inelastic Spectrum Scaling Factor, from accompanying Table 3.3)

2.6 Structural Performance Scaling Factor, Factor I

a) Structural Performance Factor, S_p

(from accompanying Figure 3.4)

Tick if light timber-framed construction in this direction

S_p = 0.93

0.93

b) Structural Performance Scaling Factor

= $1/S_p$

Factor I: 1.08

1.08

Note Factor B values for 1992 to 2004 have been multiplied by 0.67 to account for S_p in this period

2.7 Baseline %NBS for Building, (%NBS)_b

(equals (%NBS)_{nom} x E x F x G x H x I)

53%

53%

WARNING!! This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.

Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council

Street Number & Name:	135 Dowse Drive	Job No.:	5-C3957.00
AKA:		By:	GSF
Name of building:	Maungaraki Hall and Community Centre	Date:	4/09/2019
City:	Maungaraki, Hutt City	Revision No.:	0

Table IEP-3 Initial Evaluation Procedure Step 3

Step 3 - Assessment of Performance Achievement Ratio (PAR)

(Refer Appendix B - Section B3.2)

a) Longitudinal Direction

potential CSWs	Effect on Structural Performance (Choose a value - Do not interpolate)	Factors
3.1 Plan Irregularity Effect on Structural Performance <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant Insignificant impact on performance		Factor A 1.0
3.2 Vertical Irregularity Effect on Structural Performance <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant Comment: Mixed systems over different levels, minor potential for damage		Factor B 1.0
3.3 Short Columns Effect on Structural Performance <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant Comment: Nā		Factor C 1.0
3.4 Pounding Potential (Estimate D1 and D2 and set D = the lower of the two, or 1.0 if no potential for pounding, or consequences are considered to be minimal)		

a) Factor D1: - Pounding Effect

Note:
 Values given assume the building has a frame structure. For stiff buildings (eg shear walls), the effect of pounding may be reduced by taking the coefficient to the right of the value applicable to frame buildings.

Factor D1 For Longitudinal Direction: 1.0

Table for Selection of Factor D1	Severe 0<Sep<.005H	Significant .005<Sep<.01H	Insignificant Sep>.01H
Alignment of Floors within 20% of Storey Height	<input type="radio"/> 1	<input type="radio"/> 1	<input checked="" type="radio"/> 1
Alignment of Floors not within 20% of Storey Height	<input type="radio"/> 0.4	<input type="radio"/> 0.7	<input type="radio"/> 0.8
Nā			

b) Factor D2: - Height Difference Effect

Factor D2 For Longitudinal Direction: 1.0

Table for Selection of Factor D2	Severe 0<Sep<.005H	Significant .005<Sep<.01H	Insignificant Sep>.01H
Height Difference > 4 Storeys	<input type="radio"/> 0.4	<input type="radio"/> 0.7	<input checked="" type="radio"/> 1
Height Difference 2 to 4 Storeys	<input type="radio"/> 0.7	<input type="radio"/> 0.9	<input type="radio"/> 1
Height Difference < 2 Storeys	<input type="radio"/> 1	<input type="radio"/> 1	<input type="radio"/> 1
Nā			

Factor D 1.0

3.5 Site Characteristics - Stability, landslide threat, liquefaction etc as it affects the structural performance from a life-safety perspective

Effect on Structural Performance <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant	Factor E	1.0
Comment - Light slope, insignificant		

3.6 Other Factors - for allowance of all other relevant characteristics of the building

For ≤ 3 storeys - Maximum value 2.5
 otherwise - Maximum value 1.5.
 No minimum.

Factor F 1.0

Record rationale for choice of Factor F:
 Comment: Mixed systems, portal frames generally robust with simple design, F factor 1.0

3.7 Performance Achievement Ratio (PAR)

(equals A x B x C x D x E x F)

PAR
Longitudinal 1.00

WARNING!! This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.

Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council

Street Number & Name:	135 Dowse Drive	Job No.:	5-C3957.00
AKA:		By:	GSF
Name of building:	Maungaraki Hall and Community Centre	Date:	4/09/2019
City:	Maungaraki, Hutt City	Revision No.:	0

Table IEP-3 Initial Evaluation Procedure Step 3

Step 3 - Assessment of Performance Achievement Ratio (PAR)

(Refer Appendix B - Section B3.2)

b) Transverse Direction

potential CSWs	Effect on Structural Performance (Choose a value - Do not interpolate)	Factors
3.1 Plan Irregularity <i>Effect on Structural Performance</i> <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant Insignificant impact on performance		Factor A 1.0
3.2 Vertical Irregularity <i>Effect on Structural Performance</i> <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant Comment: Mixed systems over different levels, minor potential for damage		Factor B 1.0
3.3 Short Columns <i>Effect on Structural Performance</i> <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant Comment: Nil		Factor C 1.0
3.4 Pounding Potential (Estimate D1 and D2 and set D = the lower of the two, or 1.0 if no potential for pounding, or consequences are considered to be minimal)		

a) Factor D1: - Pounding Effect

Note:
Values given assume the building has a frame structure. For stiff buildings (eg shear walls), the effect of pounding may be reduced by taking the coefficient to the right of the value applicable to frame buildings.

Factor D1 For Transverse Direction: 1.0

Table for Selection of Factor D1	Severe 0<Sep<.005H	Significant .005<Sep<.01H	Insignificant Sep>.01H
Alignment of Floors within 20% of Storey Height	<input type="radio"/> 1	<input type="radio"/> 1	<input checked="" type="radio"/> 1
Alignment of Floors not within 20% of Storey Height	<input type="radio"/> 0.4	<input type="radio"/> 0.7	<input type="radio"/> 0.8

Comment: Nil

b) Factor D2: - Height Difference Effect

Factor D2 For Transverse Direction: 1.0

Table for Selection of Factor D2	Severe 0<Sep<.005H	Significant .005<Sep<.01H	Insignificant Sep>.01H
Height Difference > 4 Storeys	<input type="radio"/> 0.4	<input type="radio"/> 0.7	<input checked="" type="radio"/> 1
Height Difference 2 to 4 Storeys	<input type="radio"/> 0.7	<input type="radio"/> 0.9	<input type="radio"/> 1
Height Difference < 2 Storeys	<input type="radio"/> 1	<input type="radio"/> 1	<input type="radio"/> 1

Comment: Nil

Factor D 1.0

3.5 Site Characteristics - Stability, landslide threat, liquefaction etc as it affects the structural performance from a life-safety perspective

<i>Effect on Structural Performance</i> <input type="radio"/> Severe <input type="radio"/> Significant <input checked="" type="radio"/> Insignificant	Factor E 1.0
Comment: Nil	

3.6 Other Factors - for allowance of all other relevant characteristics of the building

For ≤ 3 storeys - Maximum value 2.5
otherwise - Maximum value 1.5.
No minimum.

Factor F 1.00

Record rationale for choice of Factor F:
Comment: Mixed systems, generally robust with simple designs but potential to interact, F factor 1.0

3.7 Performance Achievement Ratio (PAR)
(equals A x B x C x D x E x F)

PAR
Transverse 1.00

WARNING!! This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.

Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council

Street Number & Name:	135 Dowse Drive	Job No.:	5-C3957.00
AKA:		By:	GSF
Name of building:	Maungaraki Hall and Community Centre	Date:	4/09/2019
City:	Maungaraki, Hutt City	Revision No.:	0

Table IEP-4 Initial Evaluation Procedure Steps 4, 5, 6 and 7

Step 4 - Percentage of New Building Standard (%NBS)

	Longitudinal	Transverse
4.1 Assessed Baseline %NBS (%NBS) _b (from Table IEP - 1)	53%	53%
4.2 Performance Achievement Ratio (PAR) (from Table IEP - 2)	1.00	1.00
4.3 PAR x Baseline (%NBS) _b	55%	55%
4.4 Percentage New Building Standard (%NBS) - Seismic Rating (Use lower of two values from Step 4.3)		55%

Step 5 - Is %NBS < 34?

NO

Step 6 - Potentially Earthquake Risk (is %NBS < 67)?

YES

Step 7 - Provisional Grading for Seismic Risk based on IEP

Seismic Grade **C**

Additional Comments (items of note affecting IEP based seismic rating)

Comment: Nil

Relationship between Grade and %NBS:

Grade:	A+	A	B	C	D	E
%NBS:	> 100	100 to 80	79 to 67	66 to 34	< 34 to 20	< 20

WARNING!! This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.

Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council

Street Number & Name:	135 Dowse Drive	Job No.:	5-C3957.00
AKA:		By:	GSF
Name of building:	Maungaraki Hall and Community Centre	Date:	4/09/2019
City:	Maungaraki, Hutt City	Revision No.:	0

Table IEP-5 Initial Evaluation Procedure Step 8

Step 8 - Identification of potential Severe Structural Weaknesses (SSWs) that could result in significant risk to a significant number of occupants

- 8.1 Number of storeys above ground level 1
- 8.2 Presence of heavy concrete floors and/or concrete roof? (Y/N) N

Potential Severe Structural Weaknesses (SSWs):

Note: Options that are greyed out are not applicable and need not be considered.


Occupancy not considered to be significant - no further consideration required

Risk not considered to be significant - no further consideration required

The following potential Severe Structural Weaknesses (SSWs) have been identified in the building that could result in significant risk to a significant number of occupants:

- 1. None identified
- 2. Weak or soft storey (except top storey)
- 3. Brittle columns and/or beam-column joints the deformations of which are not constrained by other structural elements
- 4. Flat slab buildings with lateral capacity reliant on low ductility slab-to-column connections
- 5. No identifiable connection between primary structure and diaphragms
- 6. Ledge and gap stairs

IEP Assessment Confirmed by

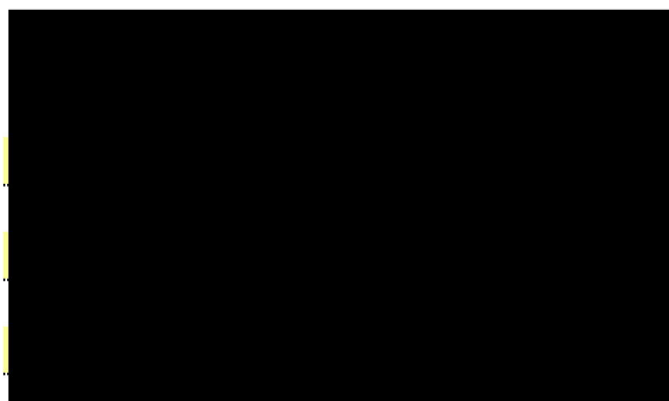


WARNING!! This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out in "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.

Initial Evaluation Procedure (IEP) Assessment - Completed for Hutt City Council

Street Number & Name:	135 Dowse Drive	Job No.:	5-C3957.00
AKA:		By:	GSF
Name of building:	Maungaraki Hall and Community Centre	Date:	4/09/2019
City:	Maungaraki, Hutt City	Revision No.:	0

Table IEP-1a Additional Photos and Sketches

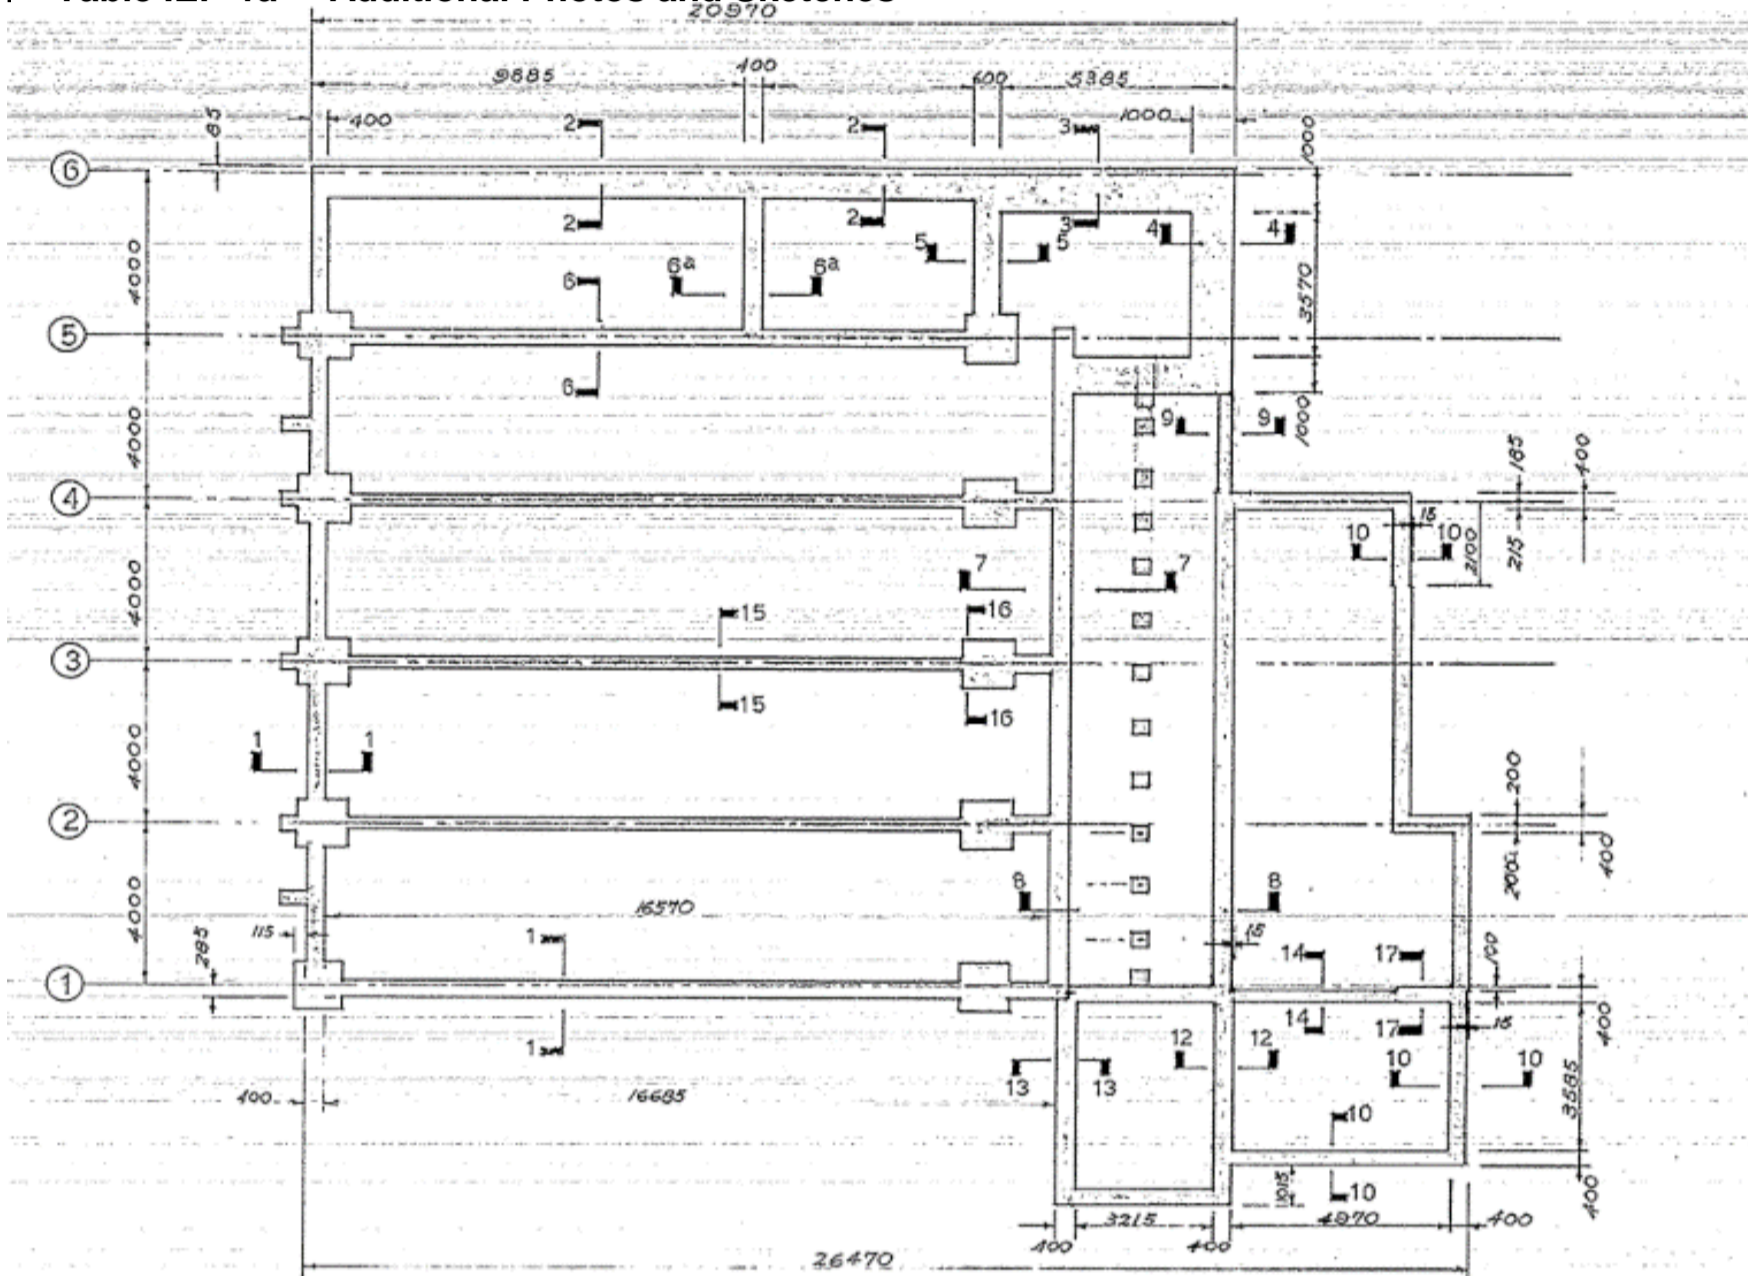

WARNING!! This initial evaluation has been carried out solely as an initial seismic assessment of the building following the procedure set out "The Seismic Assessment of Existing Buildings" Technical Guidelines for Engineering Assessments, July 2017. This spreadsheet must be read in conjunction with the limitations set out in the accompanying report, and should not be relied on by any party for any other purpose. Detailed inspections and engineering calculations, or engineering judgements based on them, have not been undertaken, and these may lead to a different result or seismic grade.

1. Building Information	
Building Name/ Description	Maungaraki Hall Community Centre
Street Address	135 Dowse Drive, Maungaraki
Territorial Authority	Hutt City Council
No. of Storeys	1 storey over 2 levels
Area of Typical Floor (approx.)	600 sqm
Year of Design (approx.)	1981
NZ Standards designed to	NZS 3604:1978
Structural System including Foundations	Mixed structural system. Steel portal frame Hall, Upper level 12mm particle braced walls with lightweight timber roof and cladding (12mm particle board diaphragm), RC Masonry walls D12@400 vertical and 2x D10@ 2nd course bond beams horizontal at lower level. Foundations: Concrete slab on grade and reinforced foundation walls and tie beams, pads under portal frames Roof, steel and timber frames supporting lightweight cladding.
Does the building comprise a shared structural form or shares structural elements with any other adjacent titles?	No
Key features of ground profile and identified geohazards	Lightly sloped across the building and wider site.
Previous strengthening and/ or significant alteration	None
Heritage Issues/ Status	Nil
Other Relevant Information	Nil

2. Assessment Information	
Consulting Practice	
CPEng Responsible, including: <ul style="list-style-type: none"> • Name • CPEng number • A statement of suitable skills and experience in the seismic assessment of existing buildings¹ 	
Documentation reviewed, including: <ul style="list-style-type: none"> • date/ version of drawings/ calculations² • previous seismic assessments 	1981 design drawings
Geotechnical Report(s)	NĀ – assumed based on local knowledge refer to section 3
Date(s) Building Inspected and extent of inspection	27 August 2019
Description of any structural testing undertaken and results summary	None
Previous Assessment Reports	NA
Other Relevant Information	Nil

¹ This should include reference to the engineer's Practice Field being in Structural Engineering, and commentary on experience in seismic assessment and recent relevant training

² Or justification of assumptions if no drawings were able to be obtained

3. Summary of Engineering Assessment Methodology and Key Parameters Used	
Occupancy Type(s) and Importance Level	Importance Level 3
Site Subsoil Class	C assumed based on local knowledge and <i>NZS1170.5:2004 Site Subsoil Classification of Lower Hutt</i> http://nzsee.org.nz/db/2011/013.pdf
<u>For an ISA:</u>	
Summary of how Part B was applied, including: <ul style="list-style-type: none"> • Key parameters such as μ, S_p and F factors • Any supplementary specific calculations 	Ductility – 1.25 Mixed systems, Steel portal frames with reinforced masonry walls. Ply braced walls Sp Factor – 0.93 for lightweight timber structure F Factor – 1.0 both directions, generally robust with simple designs but potential to interact.
<u>For a DSA:</u>	
Summary of how Part C was applied, including: <ul style="list-style-type: none"> • the analysis methodology(s) used from C2 • other sections of Part C applied 	NA
Other Relevant Information	NA

4. Assessment Outcomes		
Assessment Status (Draft or Final)	Final	
Assessed %NBS Rating	55%NBS IL3	
Seismic Grade and Relative Risk (from Table A3.1)	B, 2 to 5 times the Risk of a comparable to new building	
For an ISA:		
Describe the Potential Critical Structural Weaknesses	None identified	
Does the result reflect the building's expected behaviour, or is more information/ analysis required?	Yes – the ISA is sufficient	
If the results of this ISA are being used for earthquake prone decision purposes, <u>and</u> elements rating <34%NBS have been identified:	Engineering Statement of Structural Weaknesses and Location NA	Mode of Failure and Physical Consequence Statement(s) NA
For a DSA:		
Comment on the nature of Secondary Structural and Non-structural elements/ parts identified and assessed		
Describe the Governing Critical Structural Weakness		
If the results of this DSA are being used for earthquake prone decision purposes, <u>and</u> elements rating <34%NBS have been identified (including Parts) ³ :	Engineering Statement of Structural Weaknesses and Location	Mode of Failure and Physical Consequence Statement(s)
Recommendations (optional for EPB purposes)		

³ If a building comprises a shared structural form or shares structural elements with other adjacent titles, information about the extent to which the low scoring elements affect, or do not affect the structure.