

Demand Calculation Sheet

Job Details

Name: Cromwell (Cromwell 2)
 Street and Number: Lot 40, 42, 43, 58, 62, 64, 67, 69 & 73 Kelson Heights
 Lot and DP Number: Lot 40, 42, 43, 58, 62, 64, 67, 69 & 73 DP TBC
 City/Town/District: Lower Hutt
 Designer: E Horner
 Company: Prime Designs
 Date: Tuesday, 11 January 2022

Building Specification

Number of Storeys: 1
 Floor Loading: 2 kPa
 Foundation Type: Slab

These documents must be retained on site. Inspections may not be carried out if they are not.

Single
 Cladding Weight: Light
 Roof Weight: Light
 Room in Roof Space: No
 Roof Pitch (degrees): 25
 Roof Height above Eaves (m): 2.4
 Building Height to Apex (m): 4.9
 Ground to Lower Floor (m): 0.2

Average Stud Height (m): 2.4
 Building Length (m): 15.9
 Building Width (m): 8.3
 Building Plan Area (m²): 100

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL



Building Location

Wind Zone = High

REVISED
24/03/2022
HUTT CITY COUNCIL



Earthquake Zone 3

Soil Type: D & E (Deep to Very Soft)
 Annual Prob. of Exceedance: 1 in 500 (Default)

Bracing Units required for Wind

	Along	Across
Single Level	435	817

Bracing Units required for Earthquake

	Along & Across
Single Level	531

Single Level Along Resistance Sheet

Job Name: Cromwell (Cromwell 2)

Wind	EQ
Demand	
435	531
Achieved	

Line	Element	Length (m)	Angle (degrees)	Stud Ht. (m)	Type	Supplier	Wind (BUs)	EQ (BUs)	1190 273%	1083 204%
a	1	0.45		2.4	GS1-N	GIB®	24	26		
	2	0.50		2.4	GS1-N	GIB®	28	29		
	3	0.40		2.4	GS1-N	GIB®	21	23		
	4	3.55		2.4	GS1-N	GIB®	245	213		
External Length = 15.7									318 OK	291 OK
b	1	3.69		2.4	GS1-N	GIB®	255	221		
	2	2.00		2.4	GS1-N	GIB®	138	120		
	3	3.55		2.4	GS2-NOM	GIB®	178	178		
External Length = 5.5									570 OK	519 OK
c	1	1.28		2.4	GS1-N	GIB®	88	77		
	2	0.69		2.4	GS1-N	GIB®	41	41		
	3	1.85		2.4	GS1-N	GIB®	128	111		
	4	0.75		2.4	GS1-N	GIB®	45	44		
External Length = 15.9									302 OK	272 OK

REVISED
24/03/2022
HUTT CITY COUNCIL



BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL



Single Level Across Resistance Sheet

Job Name: Cromwell (Cromwell 2)

									Wind	EQ
									Demand	
									817	531
									Achieved	
Line	Element	Length (m)	Angle (degrees)	Stud Ht. (m)	Type	Supplier	Wind (BUs)	EQ (BUs)	1011 124%	953 179%
m	1	0.40		2.4	BL1-H	GIB®	36	40		
	2	0.40		2.4	BL1-H	GIB®	36	40		
	3	0.40		2.4	BL1-H	GIB®	36	40		
	4	0.40		2.4	BL1-H	GIB®	36	40		
External Length = 8.3									142 OK	160 OK
n	1	1.18		2.4	GS1-N	GIB®	81	71		
	2	0.59		2.4	GS2-NOM	GIB®	30	30		
									110 OK	100 OK
o	1	1.90		2.4	GS1-N	GIB®	131	114		
	2	3.12		2.4	GS1-N	GIB®	215	187		
									346 OK	301 OK
p	1	1.90		2.4	GS1-N	GIB®	131	114		
	2	1.79		2.4	GS1-N	GIB®	124	107		
									255 OK	221 OK
q	1	0.40		2.4	GS1-N	GIB®	21	23		
	2	0.40		2.4	GS1-N	GIB®	21	23		
	3	0.50		2.4	GS1-N	GIB®	28	29		
	4	0.47		2.4	BL1-H	GIB®	43	47		
	5	0.47		2.4	BL1-H	GIB®	43	47		
External Length = 8.3									157 OK	170 OK

REVISED
24/03/2022
HUTT CITY COUNCIL



BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL



Custom Wall Elements

Supplier	System	Min. Length m	Wind BUs/m	EQ BUs/m
CHH	EP1 0.4	0.4	80	95
CHH	EP1 0.6	0.6	95	105
CHH	EP1 1.2	1.2	120	135

REVISED
24/03/2022
HUTT CITY COUNCIL



BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL



DESIGN CERTIFICATE

Technical basis for structural design methodology contained in designIT for houses - New Zealand.

designIT for houses, New Zealand has been developed by experienced timber engineers to assist designers in selecting appropriate sizes of structural laminated veneer lumber products manufactured by Carter Holt Harvey LVL Limited (including hySPAN, hy90, hyONE and hyJOIST) and other generic stress grades of timber, to be used as structural elements for the construction of buildings that fall within the scope of NZS 3604.

The design methodology used for the software complies with the loading and general design requirements contained within AS/NZS 1170 and with timber structural design in accordance with NZS 3603:1993 including Amendment 4 (Verification method B1/VM1, 6.1).

designIT relies on the accurate input of span and loading information by the user. Where accurate inputs are submitted the product and/or stress grade and the size given will comply with the structural requirements of the New Zealand Building Code (NZBC), provided the installation is in accordance with the installation requirements provided by designIT and/or in product literature and/or NZS 3604, or specific engineering design, as appropriate.

Futurebuild LVL and SG8 components, when used and treated to the required treatment levels prescribed in NZS 3602 and NZS 3604, as modified by Acceptable Solution B2/AS1, will comply with the requirements of the NZBC (Acceptable Solution B2/AS1, 3.2).

References:

1. NZS 3603:1993 Timber Structures Standard.
2. NZS 3604:2011 Timber-framed buildings.
3. AS/NZS 1170:2002 Structural design actions, Parts 0 and 1.
4. AS/NZS 1170:2011 Structural design actions, Part 2: Wind actions.
5. AS/NZS 1170:2003 Structural design actions, Part 3: Snow and ice actions.
6. AS 1720.1:2010 Timber structures. Part 1: Design methods.
7. AS 1720.3:2016 Timber structures. Part 3: Design criteria for timber-framed residential buildings.

This Design Certificate, and any associated warranty/certification, is void where there has been substitution of alternate products not detailed within the Member Specification.

Version date: 5 October 2021

For further information or advice contact:

Carter Holt Harvey LVL Limited,
173 Captain Springs Road, Onehunga. Auckland
Telephone: 0800 808 131
Email: designit@futurebuild.co.nz
Web: <https://futurebuild.co.nz/>

Specifier details:

Specifier:	Reshma Ravindranath
Business name:	Carters Manufacturing Wellington
Address:	Lower Hutt
Email:	reshma.ravindranath@carters.co.nz

Project & site details:

Project:	New House Cromwell 2
Reference:	358544C1
Site address:	64 Waipounamu Drive (Cromwell2) Kelson Lower Hutt
For (owner/s):	D.M.A.C Homes Ltd T/A Friday Homes
Design wind zone	High
Snow loading	Design snow zone: N1, Altitude: 100 m (sub-alpine), Ground snow load, $S_g^{1,2} = 0.0$ kPa

designIT does not include any allowance for the effects of drifting and sliding of snow.

Snow loads are applied to roofed over structures only, the design of exposed floors/decks are not covered by designIT.

MEMBER DESIGN DETAILS

Member 1

1) Member code and description

EJ01 - Lintels - In single or upper storey load bearing walls

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL



2) Date prepared 01 December 2021

3) Serviceability criteria AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Span 1.4 m

Roof load width 'RLW' 1.8 m

Roof type and mass Light roof and ceiling - 40 kg/m²

Nominal wall thickness 90 mm

5) Member specification

Size, stress grade/product Use 150 x 90 hy90

Material type Structural Laminated Veneer Lumber to AS/NZS 4357

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - G + Ψ LQ*	4.7 mm	0.4 mm (long term)	11.0
Live load - Ψ sQ	5.6 mm	0.1 mm	45.5
Wind load - Ws	7.0 mm	0.4 mm	18.9

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions


Load case	k ₁ ¹	Limit States Design Reaction ^{2,3}
		End kN ⁴
1.35G	0.60	-1.1
1.2G + 1.5Q	0.80	-1.6
1.2G + W _u + Ψ cQ	1.00	-2.3
0.9G + W _u	1.00	1.4

8) Installation requirements

- Provide at least 30 mm bearing at end supports

Member 2

1) Member code and description EJ02 - Lintels - Supporting girder truss / truncated girder truss

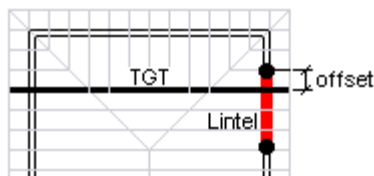

2) Date prepared 01 December 2021

3) Serviceability criteria AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Roof type Light roof and ceiling - 40 kg/m²

Roof pitch 25.0 °

Truss spacing 900 mm

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL

Eaves overhang	600 mm
TGT span	8300 mm
TGT setback	2327 mm
TGT offset	837 mm
Lintel span	2020 mm
Nominal wall thickness	90 mm

5) Member specification

Size, stress grade/product	Use 200 x 90 hy90
Material type	Structural Laminated Veneer Lumber to AS/NZS 4357

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - G + $\Psi_L Q^*$	6.7 mm	2.4 mm (long term)	2.8
Live load - $\Psi_S Q$	8.1 mm	0.7 mm	11.2
Wind load - W_S	10.1 mm	2.2 mm	4.6

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Load case	k_1^1	Limit States Design Reaction ^{2,3} End kN ⁴
1.35G	0.60	-4.1
1.2G + 1.5Q	0.80	-6.3
1.2G + W_u + $\Psi_c Q$	1.00	-8.9
0.9G + W_u	1.00	5.7

8) Installation requirements

- Provide at least 30 mm bearing at end supports

Member 3

1) Member code and description EJ03 - Lintels - In single or upper storey load bearing walls

2) Date prepared 01 December 2021

3) Serviceability criteria AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Span	0.9 m
Roof load width 'RLW'	5.1 m
Roof type and mass	Light roof and ceiling - 40 kg/m ²
Nominal wall thickness	90 mm

5) Member specification

Size, stress grade/product	Use 2/90 x 45 SG8
Material type	Dry softwood, machine stress graded and verified (NZS 3622)
Assumed design density	< 480 kg/m ³

6) Serviceability

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - $G + \Psi_L Q^*$	3.0 mm	1.7 mm (long term)	1.8
Live load - $\Psi_S Q$	3.6 mm	0.5 mm	7.0
Wind load - W_S	4.5 mm	1.5 mm	2.9

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Load case	k_1^1	Limit States Design Reaction ^{2,3} End kN ⁴
1.35G	0.60	-2.8
1.2G + 1.5Q	0.80	-4.5
1.2G + W_u + $\Psi_c Q$	1.00	-6.3
0.9G + W_u	1.00	4.2

8) Installation requirements

- Provide at least 30 mm bearing at end supports
- Vertical lamination required - refer AS 1684

Member 4**1) Member code and description** EJ04 - Lintels - In single or upper storey load bearing walls**2) Date prepared** 01 December 2021**3) Serviceability criteria** AS 1720.1: 2010 and AS 1720.3: 2016**4) Design inputs**

Span	0.9 m
Roof load width 'RLW'	5.1 m
Roof type and mass	Light roof and ceiling - 40 kg/m ²
Nominal wall thickness	90 mm

5) Member specification

Size, stress grade/product	Use 2/90 x 45 SG8
Material type	Dry softwood, machine stress graded and verified (NZS 3622)
Assumed design density	< 480 kg/m ³

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - $G + \Psi_L Q^*$	3.0 mm	1.7 mm (long term)	1.8
Live load - $\Psi_S Q$	3.6 mm	0.5 mm	7.0
Wind load - W_S	4.5 mm	1.5 mm	2.9

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Load case	k_1^1	Limit States Design Reaction ^{2,3} End kN ⁴
1.35G	0.60	-2.8

BUILDING CONSENT**GRANTED**
29/03/2022**HUTT CITY COUNCIL**

1.2G + 1.5Q	0.80	-4.5
1.2G + W _u + $\Psi_c Q$	1.00	-6.3
0.9G + W _u	1.00	4.2

8) Installation requirements

- Provide at least 30 mm bearing at end supports
- Vertical lamination required - refer AS 1684

Member 5

1) Member code and description EJ05 - Lintels - In single or upper storey load bearing walls

2) Date prepared 01 December 2021

3) Serviceability criteria AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Span	2.1 m
Roof load width 'RLW'	5.1 m
Roof type and mass	Light roof and ceiling - 40 kg/m ²
Nominal wall thickness	90 mm

5) Member specification

Size, stress grade/product	Use 150 x 90 hy90
Material type	Structural Laminated Veneer Lumber to AS/NZS 4357

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - G + $\Psi_L Q^*$	7.0 mm	3.9 mm (long term)	1.8
Live load - $\Psi_s Q$	8.4 mm	1.2 mm	7.1
Wind load - W _s	10.5 mm	3.5 mm	3.0

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Load case	k ₁ ¹	Limit States Design Reaction ^{2,3} End kN ⁴
1.35G	0.60	-4.1
1.2G + 1.5Q	0.80	-6.5
1.2G + W _u + $\Psi_c Q$	1.00	-9.1
0.9G + W _u	1.00	5.9

8) Installation requirements

- Provide at least 30 mm bearing at end supports


Member 6

1) Member code and description EJ06 - Lintels - Supporting girder truss / truncated girder truss

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL

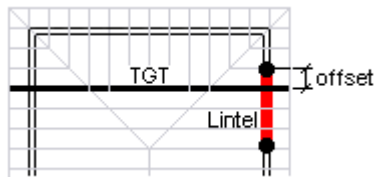

2) Date prepared

01 December 2021

3) Serviceability criteria

AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Roof type	Light roof and ceiling - 40 kg/m ²
Roof pitch	25.0 °
Truss spacing	900 mm
Eaves overhang	600 mm
TGT span	4320 mm
TGT setback	1405 mm
TGT offset	465 mm
Lintel span	2020 mm
Nominal wall thickness	90 mm

5) Member specification

Size, stress grade/product	Use 150 x 90 hy90
Material type	Structural Laminated Veneer Lumber to AS/NZS 4357

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - G + $\Psi_L Q^*$	6.7 mm	2.8 mm (long term)	2.4
Live load - $\Psi_S Q$	8.1 mm	0.8 mm	9.9
Wind load - W_S	10.1 mm	2.5 mm	4.1

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Load case	k_1^1	Limit States Design Reaction ^{2,3} End kN ⁴
1.35G	0.60	-2.0
1.2G + 1.5Q	0.80	-3.1
1.2G + W_u + $\Psi_c Q$	1.00	-4.3
0.9G + W_u	1.00	2.7

8) Installation requirements

- Provide at least 30 mm bearing at end supports

Member 7

1) Member code and description

EJ07 - Lintels - In single or upper storey load bearing walls

2) Date prepared

01 December 2021

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL

3) Serviceability criteria AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Span	3.1 m
Roof load width 'RLW'	1.3 m
Roof type and mass	Light roof and ceiling - 40 kg/m ²
Nominal wall thickness	90 mm

5) Member specification

Size, stress grade/product	Use 200 x 90 hy90
Material type	Structural Laminated Veneer Lumber to AS/NZS 4357

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - $G + \Psi_L Q^*$	10.0 mm	2.7 mm (long term)	3.7
Live load - $\Psi_S Q$	12.4 mm	0.7 mm	17.6
Wind load - W_s	15.5 mm	2.1 mm	7.3

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Load case	k_1^1	Limit States Design Reaction ^{2,3}
		End kN ⁴
1.35G	0.60	-1.5
1.2G + 1.5Q	0.80	-2.3
1.2G + W_u + $\Psi_c Q$	1.00	-3.1
0.9G + W_u	1.00	1.8

8) Installation requirements

- Provide at least 30 mm bearing at end supports

Member 8

1) Member code and description EJ08 - Lintels - In single or upper storey load bearing walls

2) Date prepared 01 December 2021

3) Serviceability criteria AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Span	0.9 m
Roof load width 'RLW'	1.0 m
Roof type and mass	Light roof and ceiling - 40 kg/m ²
Nominal wall thickness	90 mm

5) Member specification

Size, stress grade/product	Use 2/90 x 45 SG8
Material type	Dry softwood, machine stress graded and verified (NZS 3622)
Assumed design density	< 480 kg/m ³

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - $G + \Psi_L Q^*$	3.0 mm	0.3 mm (long term)	8.9
Live load - $\Psi_S Q$	3.6 mm	0.1 mm	35.9
Wind load - W_s	4.5 mm	0.3 mm	14.9

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Load case	k_1^1	Limit States Design Reaction ^{2,3} End kN ⁴
1.35G	0.60	-0.6
1.2G + 1.5Q	0.80	-0.9
1.2G + W_u + $\Psi_c Q$	1.00	-1.3
0.9G + W_u	1.00	0.8

8) Installation requirements

- Provide at least 30 mm bearing at end supports
- Vertical lamination required - refer AS 1684

Member 9**1) Member code and description** EJ09 - Lintels - In single or upper storey load bearing walls**2) Date prepared** 01 December 2021**3) Serviceability criteria** AS 1720.1: 2010 and AS 1720.3: 2016**4) Design inputs**

Span	2.3 m
Roof load width 'RLW'	1.8 m
Roof type and mass	Light roof and ceiling - 40 kg/m ²
Nominal wall thickness	90 mm

5) Member specification

Size, stress grade/product	Use 150 x 90 hy90
Material type	Structural Laminated Veneer Lumber to AS/NZS 4357

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - $G + \Psi_L Q^*$	7.7 mm	2.0 mm (long term)	3.9
Live load - $\Psi_S Q$	9.2 mm	0.5 mm	16.9
Wind load - W_s	11.5 mm	1.6 mm	7.0

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Load case	k_1^1	Limit States Design Reaction ^{2,3} End kN ⁴
1.35G	0.60	-1.6

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL

1.2G + 1.5Q	0.80	-2.5
1.2G + W _u + $\Psi_c Q$	1.00	-3.5
0.9G + W _u	1.00	2.1

8) Installation requirements

- Provide at least 30 mm bearing at end supports

Member 10

1) Member code and description EJ10 - Lintels - In single or upper storey load bearing walls

2) Date prepared 01 December 2021

3) Serviceability criteria AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Span	0.7 m
Roof load width 'RLW'	5.1 m
Roof type and mass	Light roof and ceiling - 40 kg/m ²
Nominal wall thickness	90 mm

5) Member specification

Size, stress grade/product	Use 2/90 x 45 SG8
Material type	Dry softwood, machine stress graded and verified (NZS 3622)
Assumed design density	< 480 kg/m ³

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - G + $\Psi_L Q^*$	2.3 mm	0.8 mm (long term)	3.0
Live load - $\Psi_s Q$	2.8 mm	0.2 mm	11.6
Wind load - W _s	3.5 mm	0.7 mm	4.8

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Load case	k ₁ ¹	Limit States Design Reaction ^{2,3} End kN ⁴
1.35G	0.60	-2.7
1.2G + 1.5Q	0.80	-4.2
1.2G + W _u + $\Psi_c Q$	1.00	-6.0
0.9G + W _u	1.00	3.9

8) Installation requirements

- Provide at least 30 mm bearing at end supports
- Vertical lamination required - refer AS 1684

Member 11

1) Member code and description EJ11 - Lintels - In single or upper storey load bearing walls

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL

2) Date prepared 01 December 2021

3) Serviceability criteria AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Span 2.1 m

Roof load width 'RLW' 5.1 m

Roof type and mass Light roof and ceiling - 40 kg/m²

Nominal wall thickness 90 mm

5) Member specification

Size, stress grade/product Use 150 x 90 hy90

Material type Structural Laminated Veneer Lumber to AS/NZS 4357

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - G + Ψ LQ*	7.0 mm	3.9 mm (long term)	1.8
Live load - Ψ sQ	8.4 mm	1.2 mm	7.1
Wind load - Ws	10.5 mm	3.5 mm	3.0

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Load case	k ₁ ¹	Limit States Design Reaction ^{2,3}
		End kN ⁴
1.35G	0.60	-4.1
1.2G + 1.5Q	0.80	-6.5
1.2G + W _u + Ψ cQ	1.00	-9.1
0.9G + W _u	1.00	5.9

8) Installation requirements

- Provide at least 30 mm bearing at end supports

Member 12

1) Member code and description EJ12 - Lintels - In single or upper storey load bearing walls

2) Date prepared 01 December 2021

3) Serviceability criteria AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Span 0.7 m

Roof load width 'RLW' 5.1 m

Roof type and mass Light roof and ceiling - 40 kg/m²

Nominal wall thickness 90 mm

5) Member specification

Size, stress grade/product Use 2/90 x 45 SG8

Material type Dry softwood, machine stress graded and verified (NZS 3622)

Assumed design density < 480 kg/m³

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - $G + \Psi_L Q^*$	2.3 mm	0.8 mm (long term)	3.0
Live load - $\Psi_S Q$	2.8 mm	0.2 mm	11.6
Wind load - W_S	3.5 mm	0.7 mm	4.8

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Load case	k_1^1	Limit States Design Reaction ^{2,3} End kN ⁴
1.35G	0.60	-2.7
1.2G + 1.5Q	0.80	-4.2
1.2G + W_u + $\Psi_c Q$	1.00	-6.0
0.9G + W_u	1.00	3.9

8) Installation requirements

- Provide at least 30 mm bearing at end supports
- Vertical lamination required - refer AS 1684

Member 13

1) Member code and description EJ13 - Lintels - In single or upper storey load bearing walls

2) Date prepared 01 December 2021

3) Serviceability criteria AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Span	2.1 m
Roof load width 'RLW'	2.3 m
Roof type and mass	Light roof and ceiling - 40 kg/m ²
Nominal wall thickness	90 mm

5) Member specification

Size, stress grade/product	Use 150 x 90 hy90
Material type	Structural Laminated Veneer Lumber to AS/NZS 4357

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - $G + \Psi_L Q^*$	7.0 mm	1.9 mm (long term)	3.8
Live load - $\Psi_S Q$	8.4 mm	0.5 mm	15.8
Wind load - W_S	10.5 mm	1.6 mm	6.8

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Limit States Design Reaction ^{2,3}

BUILDING CONSENT

GRANTED

29/03/2022

HUTT CITY COUNCIL

Load case	k_1^1	End kN^4
1.35G	0.60	-1.9
1.2G + 1.5Q	0.80	-3.0
1.2G + W_u + $\Psi_c Q$	1.00	-4.2
0.9G + W_u	1.00	2.6

8) Installation requirements

- Provide at least 30 mm bearing at end supports

Member 14

1) Member code and description EJ14 - Lintels - In single or upper storey load bearing walls

2) Date prepared 01 December 2021

3) Serviceability criteria AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Span	2.1 m
Roof load width 'RLW'	1.4 m
Roof type and mass	Light roof and ceiling - 40 kg/m ²
Nominal wall thickness	90 mm

5) Member specification

Size, stress grade/product	Use 150 x 90 hy90
Material type	Structural Laminated Veneer Lumber to AS/NZS 4357

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - G + $\Psi_L Q^*$	7.0 mm	1.2 mm (long term)	5.9
Live load - $\Psi_s Q$	8.4 mm	0.3 mm	26.0
Wind load - W_s	10.5 mm	1.0 mm	10.8

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

		Limit States Design Reaction ^{2,3}
Load case	k_1^1	End kN^4
1.35G	0.60	-1.2
1.2G + 1.5Q	0.80	-1.8
1.2G + W_u + $\Psi_c Q$	1.00	-2.6
0.9G + W_u	1.00	1.6

8) Installation requirements

- Provide at least 30 mm bearing at end supports

Member 15

1) Member code and description GD01 - Lintels - In single or upper storey load bearing walls

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL

2) Date prepared 01 December 2021

3) Serviceability criteria AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Span 2.5 m

Roof load width 'RLW' 1.8 m

Roof type and mass Light roof and ceiling - 40 kg/m²

Nominal wall thickness 90 mm

5) Member specification

Size, stress grade/product Use 150 x 90 hy90

Material type Structural Laminated Veneer Lumber to AS/NZS 4357

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - G + $\Psi_L Q^*$	8.3 mm	2.8 mm (long term)	2.9
Live load - $\Psi_S Q$	10.0 mm	0.8 mm	12.8
Wind load - W_s	12.5 mm	2.4 mm	5.3

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Load case	k_1^1	Limit States Design Reaction ^{2,3}
		End kN ⁴
1.35G	0.60	-1.7
1.2G + 1.5Q	0.80	-2.6
1.2G + W_u + $\Psi_c Q$	1.00	-3.6
0.9G + W_u	1.00	2.2

8) Installation requirements

- Provide at least 30 mm bearing at end supports

Member 16

1) Member code and description Entry Beam - Lintels - In single or upper storey load bearing walls

2) Date prepared 01 December 2021

3) Serviceability criteria AS 1720.1: 2010 and AS 1720.3: 2016

4) Design inputs

Span 2.0 m

Roof load width 'RLW' 1.8 m

Roof type and mass Light roof and ceiling - 40 kg/m²

Nominal wall thickness 90 mm

5) Member specification

Size, stress grade/product Use 150 x 90 hy90

Material type Structural Laminated Veneer Lumber to AS/NZS 4357

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL

6) Serviceability

Load case	Limit ³ on average deflection ²	Estimated average deflection ²	Rigidity ratio ⁴
Long term load - $G + \Psi_L Q^*$	6.7 mm	1.3 mm (long term)	5.2
Live load - $\Psi_S Q$	8.0 mm	0.4 mm	22.3
Wind load - W_S	10.0 mm	1.1 mm	9.2

*Critical serviceability load case

See 'Notes for interpretation of serviceability data' at the end of this report

7) Reactions

Load case	k_1 ¹	Limit States Design Reaction ^{2,3} End kN ⁴
1.35G	0.60	-1.5
1.2G + 1.5Q	0.80	-2.3
1.2G + W_u + $\Psi_c Q$	1.00	-3.2
0.9G + W_u	1.00	2.0

8) Installation requirements

- Provide at least 30 mm bearing at end supports

Notes for interpretation of serviceability data

- 'average deflection' is an engineering concept based upon a notional estimated load, notional member rigidity and, in some cases, an approximate model of material response to environmental conditions. These parameters are, 'standardised' in AS 1170 and AS 1720.
- Deflection is the flexural response to load 'out-of-level' measurements of installations are not necessarily deflections and can incorporate 'initial out-of-straightness', whether intended or not. Furthermore, loads can be higher/lower than the notional estimate and in any comparison with measured levels, material variability needs to also be considered. AS 1720 gives the following basis for estimation of upper bound deflections for various materials.

No 1 Framing – visually graded to NZS 3631	Average + 100%
SG grades - mechanically graded to AS/NZS 1748	Average + 43%
GL grades for glulam to AS 1328	Average + 33%
LVL to AS/NZS 4357 (includes hySPAN and hyJOIST)	Average +18%

As can be seen, comparison of the 'average deflection' for different materials, even if calculated on the same basis, does not give the whole picture!


- The limits referred are those specified in AS 1720.3 for the stated load case.
- 'Rigidity ratio' expresses the rigidity of the specified beam relative to the rigidity of a notional beam just meeting the serviceability requirements detailed.

Notes for interpretation of reaction data

- Duration of load factor ' k_1 ' for strength as per NZS 3603:1993
- Negative (-) reactions relate to the 'gravity' or 'downwards' force on the support
- Positive reactions relate to the 'upwards' forces or 'tie-down' requirement on the support
- End reaction includes allowance for overhang/cantilever where one has been designed

BUILDING CONSENT**GRANTED**
29/03/2022**HUTT CITY COUNCIL**

For valley/saddle truss fixing unless stated otherwise use a pair of wire dogs at 900mm centres for up to and including a very high wind zone. Or a pair of CT200's at 900mm centres for extra high wind zone. This fixing is to meet the minimum requirements as per NZS3604.

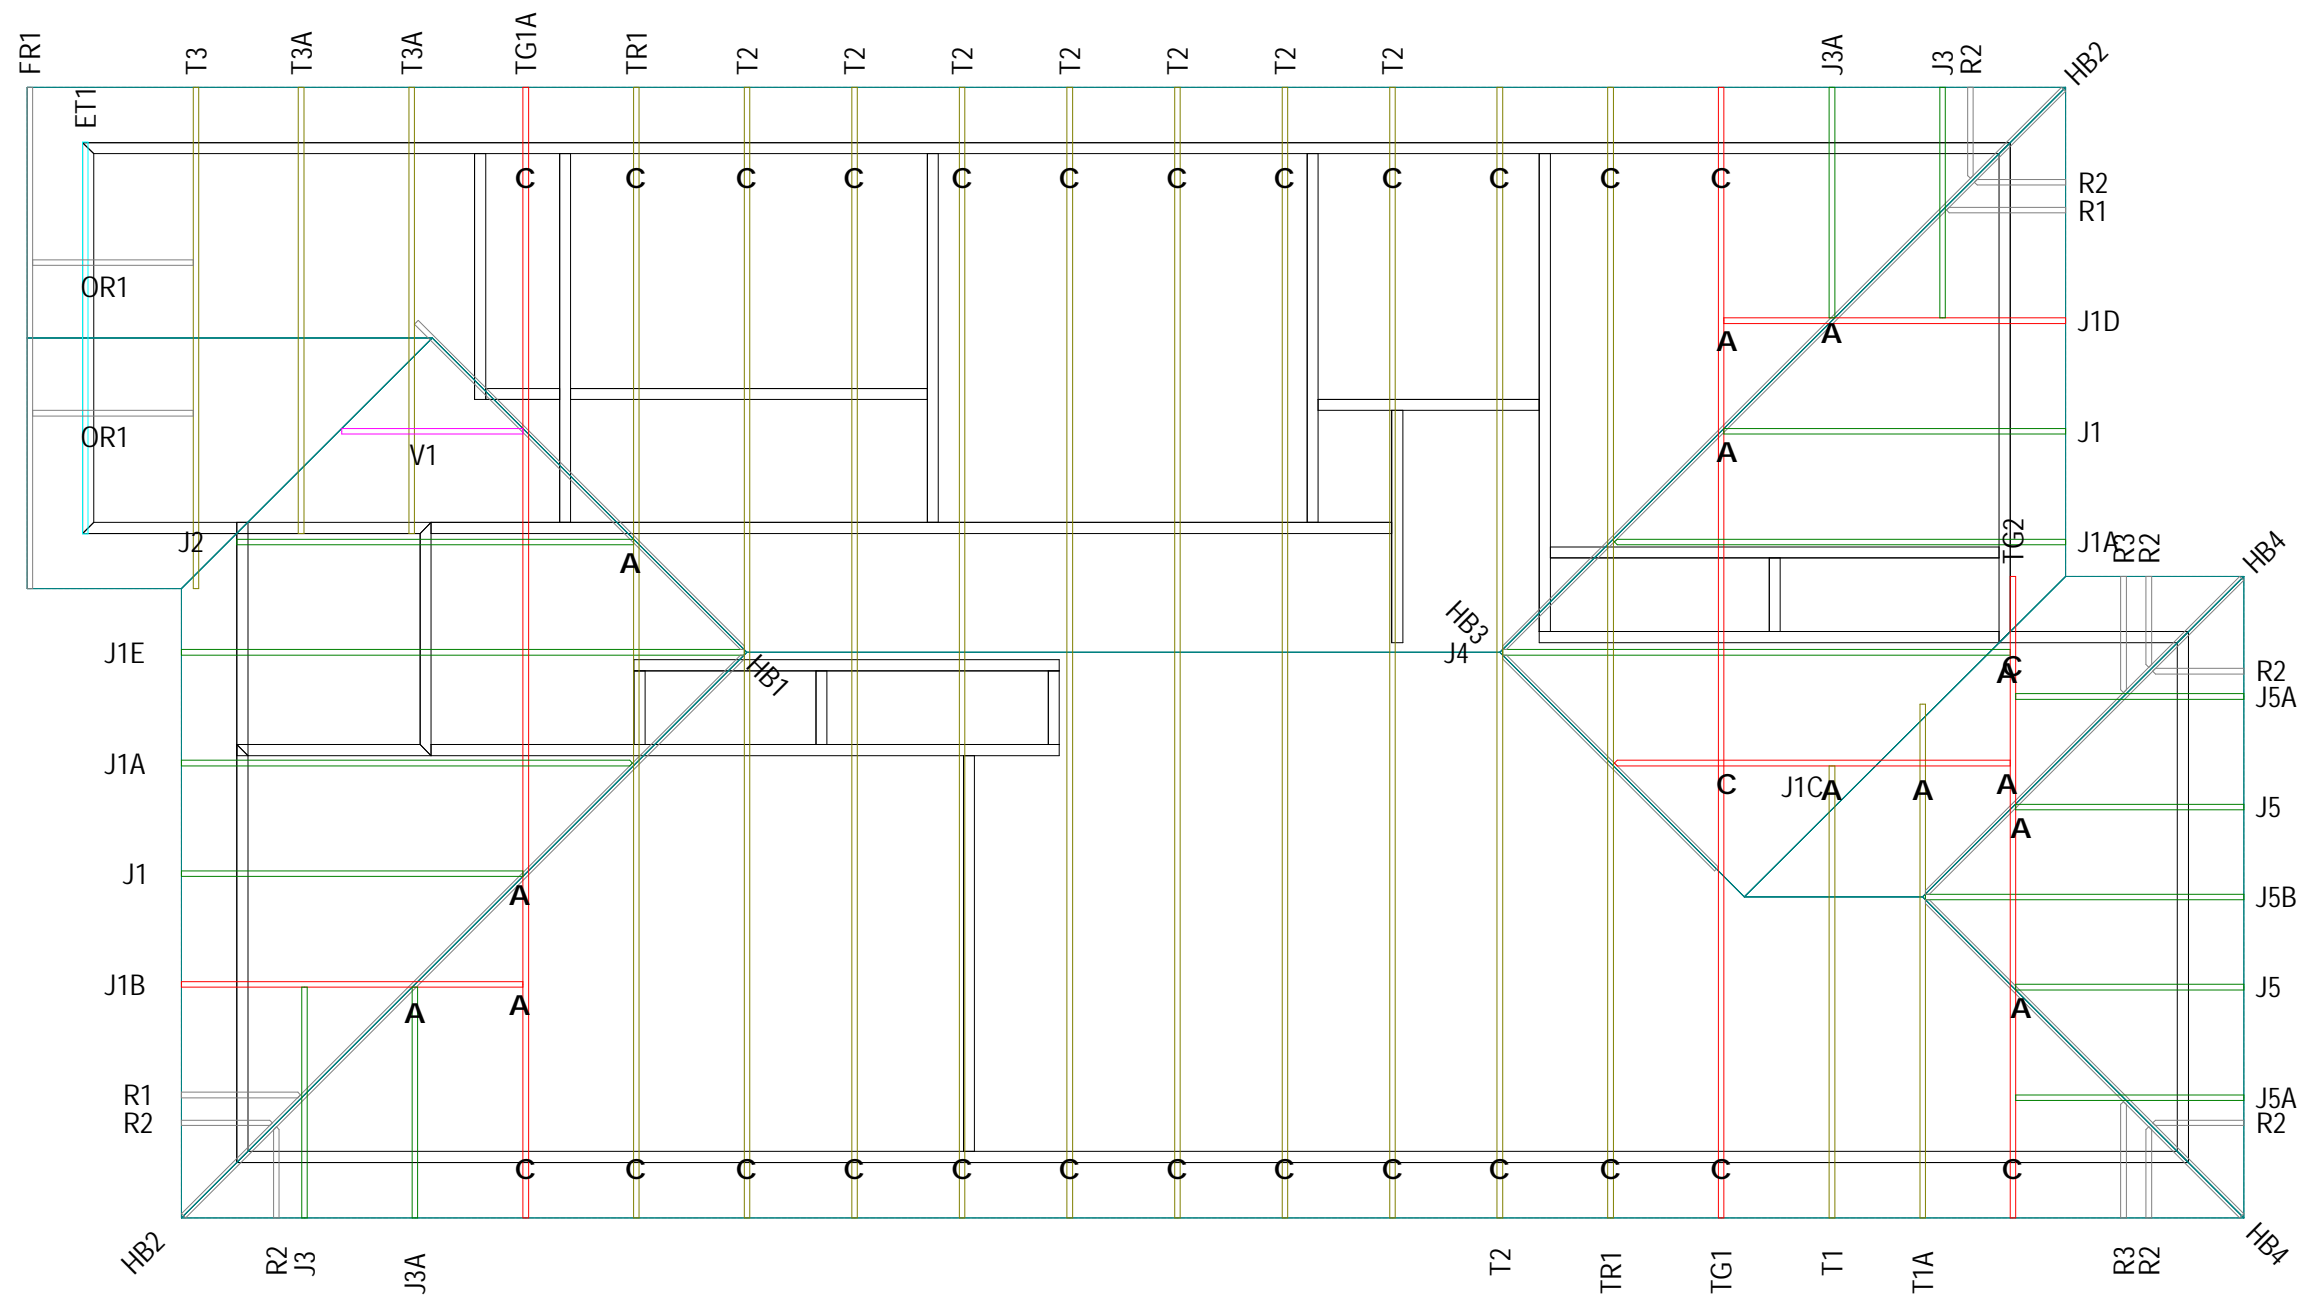

Truss Layout




BUILDABLE CONSENT LAYOUT



**Your
Building Partner**

BC220149

CARTERS Wellington Manufacturing (04) 5670287	
JOB No 358544C1	
Client: DMAC Homes Ltd T/A Friday Homes Job: New House- Cromwell 2 Site: 64 Waipounamu Drive (Cromwell 2) Kelson Lower Hutt	
Pitch: 25.0deg Roof Type: Longrun Overhang: 450mm Wind Area: High Roof Snow: 0.000kPa	
Trusses and rafters at 900 mm max centres unless stated otherwise. This layout is to be read in conjunction with the Architectural plans.	
DRAWN Reshma	1 Dec,2021
<div> <div> Dn kN </div> <div> Up kN </div> </div> Ultimate Limit State Loads	
Notification of point loaded lintels or point loads on internal walls where the downward load is higher than 8kN (85mm raft type slab) or 10kN (100mm standard slab), or the upward load is greater than 10kN.	
Any roof loads as stated on this layout over 16kN up or down are outside the scope of NZS3604, and the architect / draughtsperson is responsible for the design to transfer the loads to the ground.	
The lintels have been sized using one of the following:	
hy90, hyONE and hySPAN lintels have been sized using the designIT for houses - New Zealand series 6 software.	
GANGLAM and FLITCH BEAMS have been sized using the MiTek Beam Program V1.10 June 2011.	
Unless otherwise stated the timber grade for all lintels is SG8. Lintels not shown are to be selected as per NZS3604: 2011.	

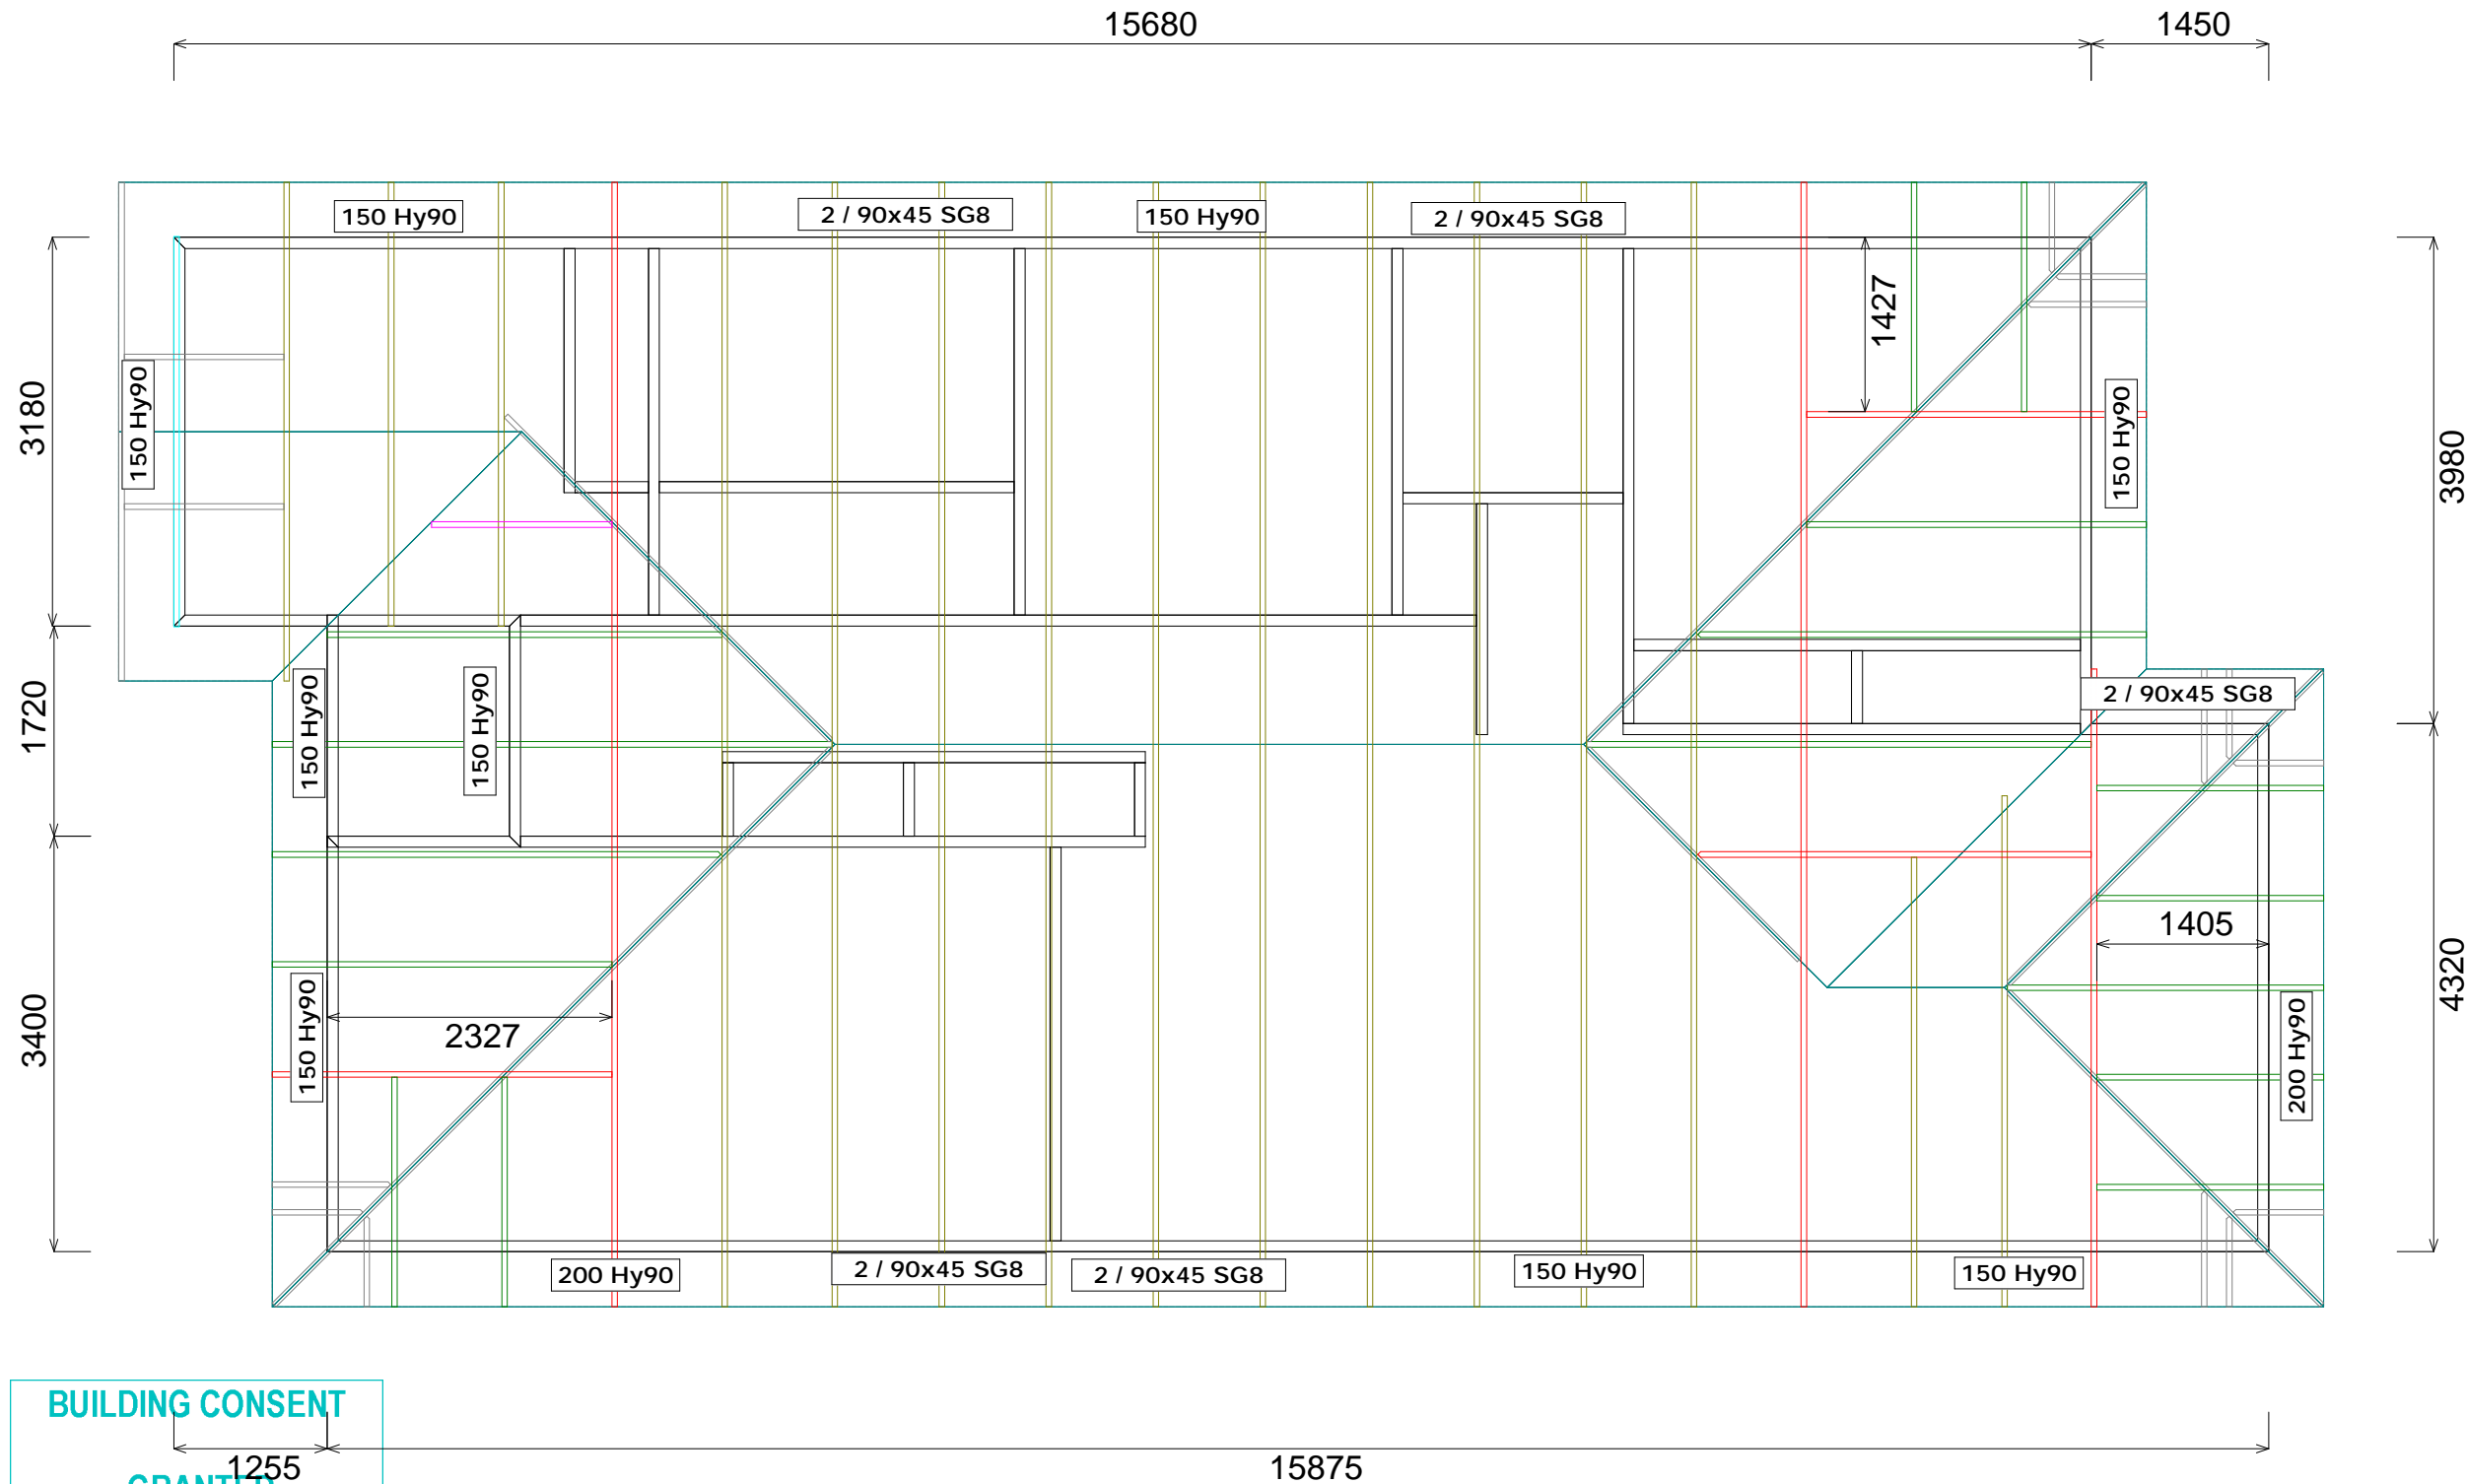

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL



All internal walls shown hatched on this layout are considered to be loadbearing
Lintel fixing specification remains the responsibility of the architect / draughtsperson



Correspondence from : **AUCKLAND**
40 Neales Road, East Tamaki 2013
PO Box 58-014, Botany 2163
Phone: 09 274 7109
Fax: 09 274 7100

CHRISTCHURCH
14 Pilkington Way, Wigram 8042
PO Box 8387, Riccarton 8440
Phone: 03 348 8691
Fax: 03 348 0314

www.mitek.nz.co.nz

MiTek 20/20 Engineering 4.7.346.0

Printed: 15:49:58 07 Dec 2021

PRODUCER STATEMENT for MiTek 20/20[®] TRUSS DESIGN - Version 4.7

ISSUED BY: MiTek New Zealand Limited

TO: CARTERS

IN RESPECT OF: MiTek[®] Truss Designs

This producer statement covers the MiTek 20/20[®] truss design and the structural performance of the GANG-NAIL[®] connector plate for the job reference **358544C1** and may be used by a Building Consent Authority to assist in determining compliance with the New Zealand Building Code.

The MiTek 20/20[®] truss design program has been developed by MiTek New Zealand Limited for the design of MiTek[®] timber roof, floor and attic trusses in New Zealand. The truss designs computed by MiTek 20/20[®] are prepared using sound and widely accepted engineering principles, and in accordance with compliance documents of the New Zealand Building Code and Verification Method B1/VM1; and internationally accepted standard ANSI/TPI 1 - 2002 as an alternative solution, to satisfy the requirements of Clause B1 of the New Zealand Building Code.

On behalf of MiTek New Zealand Limited, and subject to:

- i) All proprietary products meeting their performance specification requirements
- ii) The provision of adequate roof bracing and overall building stability
- iii) Correct selection and placement of GANG-NAIL connector plates
- iv) Correct input of Truss Design Data as shown in the Fabricator Design Statement for this job
- v) The design being undertaken by the accredited fabricator under the terms of the software licence
- vi) Timber is graded to the requirements of NZS 3603:1993
- vii) Minimum timber treatment for these MiTek[®] trusses shall be in accordance with B2/AS1 Table 1A and the relevant sections of NZS 3602:2003

I believe on reasonable grounds that the trusses, if constructed in accordance with the MiTek 20/20[®] truss design and shop drawings, will comply with the relevant provisions of the New Zealand Building Code.

MiTek New Zealand Limited holds a current policy of Professional Indemnity Insurance no less than \$500,000.

On behalf of MiTek New Zealand Limited,

Date: Tuesday, 7 December 2021

In Ling Ng, BE (Hons), CPEng, IntPE, MIPENZ (ID: 146585)
TECHNICAL SERVICES MANAGER, MiTek New Zealand Limited

BUILDING CONSENT

GRANTED
29/03/2022

HUTT CITY COUNCIL



Job: 358544C1

Client: DMAC Homes Ltd T/A Friday Homes
Phone:Site: New House- Cromwell 2
64 Waipounamu Drive (Cromwell 2)
Kelso
Lower HuttDescription:
Building Consent No.:
MiTek 20/20 Engineering 4.7.346.0

MiTek New Zealand Limited

Phone:

Printed: 15:49:58 07 Dec 2021

MITEK FABRICATOR DESIGN STATEMENT

This statement is issued by MiTek accredited fabricator **CARTERS**, being licensed to use the MiTek 20/20® software, to the client listed above and may be used by the Building Consent Authority to assist in determining compliance with the New Zealand Building Code.

MiTek 20/20® TRUSS DESIGN DATA

The MiTek 20/20® computer design for this job is based on the following design parameters entered into the program. The Fabricator shall ensure that these job details are current and relevant to the project for the design of the MiTek® trusses.

Job Details		Importance Level :	2	Design Working Life :	50 years
Roof Truss					
Timber Group:	MSG8 DDP H1.2	Pitch:	25.000 deg	Nominal Overhang:	450 mm
Roof		Ceiling		Wind	
Material:	Longrun	Material:	Gib 13mm/Rondo Screwed	Area:	High (44.0 m/s)
Dead Load:	0.210 kPa	Dead Load:	0.200 kPa	Pressure Coeff:	Cpe = varies; Cpi = -0.30, 0.20
Restraints:	900 mm centres	Restraints:	600 mm centres		
Live Load:	Q _{ur} = 0.250 kPa	Live Load:	Q _c = 1.400 kN		
	Q _c = 1.100 kN				

The minimum timber treatment for these MiTek® trusses shall be in accordance with B2/AS1 Table 1A and the relevant sections of NZS 3602:2003. The timber for these MiTek® trusses shall be graded to the requirements of NZS 3603:1993. Proprietary fixings and timber connectors shall be selected in accordance with NZS3604:2011 Section 4 - Durability.

MiTek® Truss List

Legend: * = detail only, ? = input only, Txx = failed design, Ø = non certified, Unmarked trusses = designed successfully, LB = lateral bracing required
GB = gable brace required

Truss	Qty	Span (mm)	Pitch (deg)	Spacing (mm)	Truss	Qty	Span (mm)	Pitch (deg)	Spacing (mm)	Truss	Qty	Span (mm)	Pitch (deg)	Spacing (mm)
ET1	1	3189	25.000	900	*OR1	2	1305	0.000	900	J3A	2	1427	25.000	900
*FR1	1	4080	25.000	900	*R1	2	968	25.000	900	J5A	2	1405	25.000	900
*HB1	1	3771	18.249	900	*R2	8	741	25.000	900	J5B	1	1405	25.000	900
*HB2	2	6451	18.249	900	*R3	2	946	25.000	900	T1	1	3227	25.000	900
*HB3	1	2460	18.249	900	T1A	1	3227	25.000	900	T3A	2	3180	25.000	900
*HB4	2	3637	18.249	900	T2	8	8300	25.000	900	J1B	1	2327	25.000	900
J1	2	2327	25.000	900	T3	1	3180	25.000	900	J1C	1	2327	25.000	900
J2	1	3227	25.000	900	TR1	2	8300	25.000	900	J1D	1	2327	25.000	900
J3	2	1427	25.000	900	V1	1	1474	25.000	900	TG1	1	8300	25.000	900
J4	1	2327	25.000	900	J1A	2	2327	25.000	900	TG2	1	4320	25.000	900
J5	2	1405	25.000	900	J1E	1	2327	25.000	900	TG1A	1	8300	25.000	900

Total quantity : 60

The computer design input has been carried out by:

MiTek 20/20 Software Operator: Reshma

MiTek Candidate Number and Qualifications: Ravindranath

Accredited Fabricator:

**BUILDING CONSENT****GRANTED**
29/03/2022**HUTT CITY COUNCIL**

Tuesday, 7 December 2021

